


ALL DIMENSIONS SHOWN ARE IN METRES AND/OR MILLIMETRES UNLESS OTHERWISE NOTED.

- NOTES:
1. ALL DISTRIBUTION PANES SHALL BE WALL MOUNTED ON UNITSTRUT CHANNEL (I.E.:" SPACED OFF WALL).
 2. COMMUNICATION RACK RECEPTACLES L5-20R MOUNTED ON CABLE TRAY ABOVE COMMUNICATION RACK.
 3. REFER TO ELECTRIFICATION STANDARDS AND SPECIFICATIONS FOR GROUNDING AND BONDING, EMI/EMF WITHSTAND REQUIREMENTS, CABLING REQUIREMENTS

NOTE:
THIS DRAWING IS PROVIDED FOR INSTRUCTIONAL DESIGN PURPOSES ONLY BASED ON METROLINX GO TRANSIT DESIGN GUIDELINES AND REQUIREMENTS. THE CONSULTANT SHALL VERIFY FOR LOCAL CODE COMPLIANCE, EXISTING SITE CONDITIONS AND INTER DISCIPLINARY DRAWING COORDINATION. ALL DIMENSIONS AND SPECIFICATIONS SHOULD BE VERIFIED BY CONSULTANT AND/OR CONTRACTOR BEFORE ACTUAL CONSTRUCTION BEGINS.

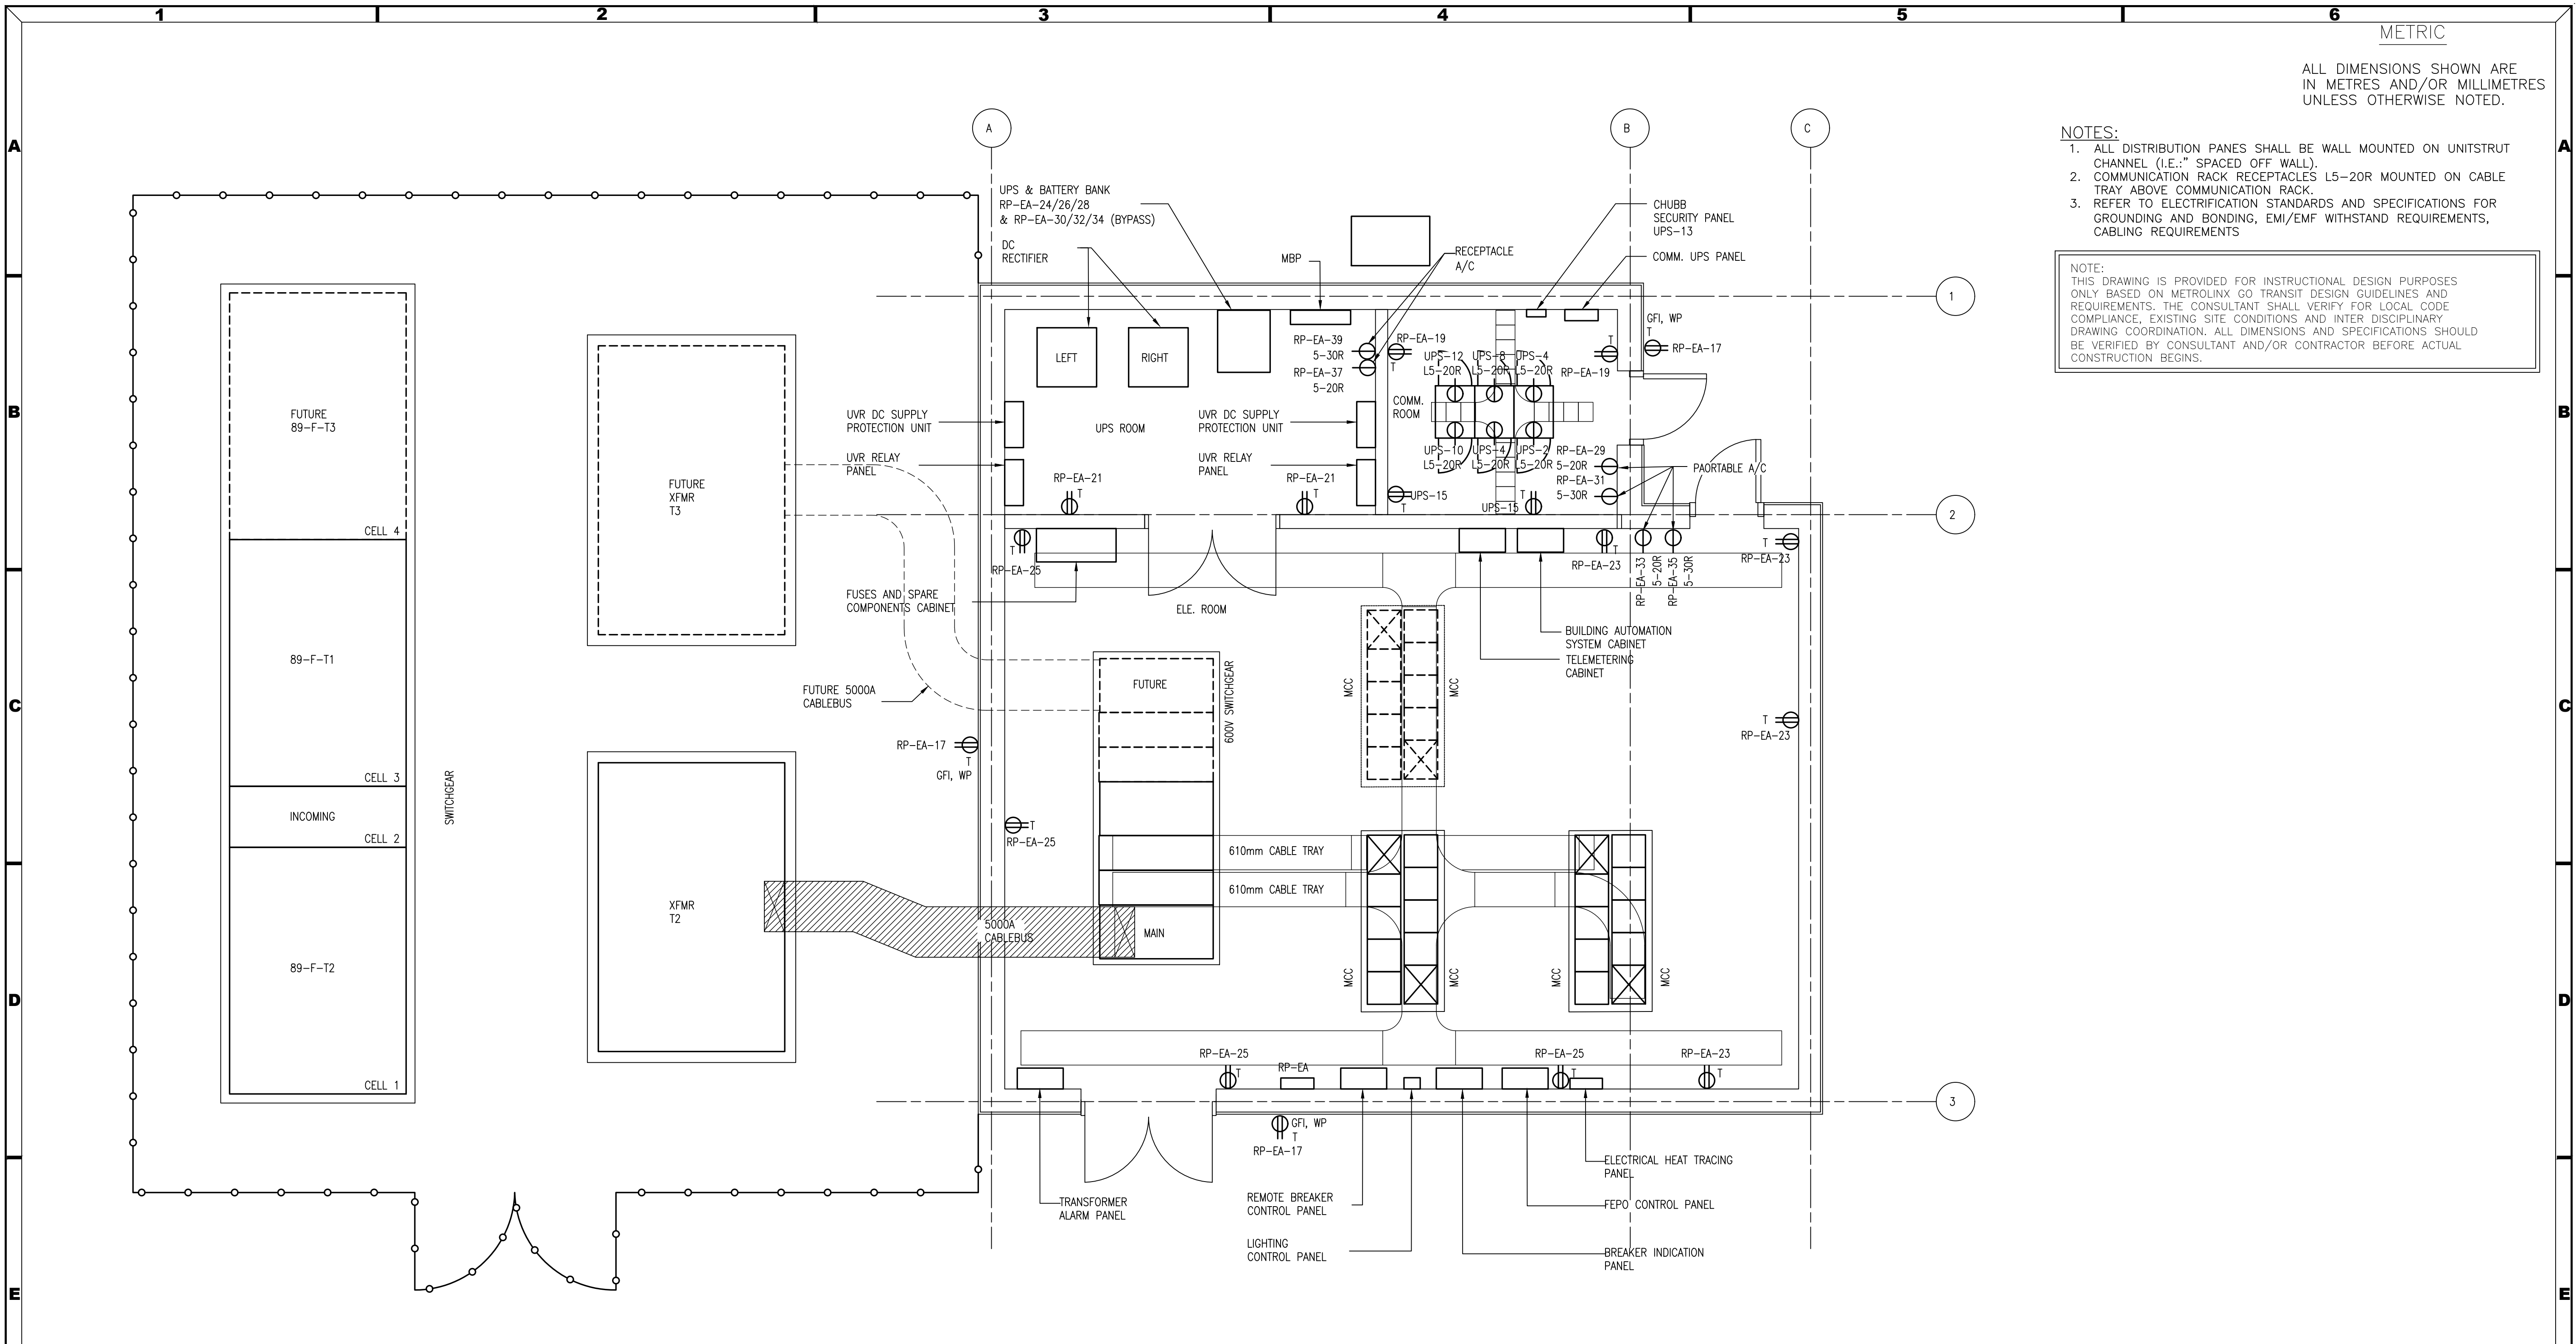

1 SUBSTATION BUILDING GENERAL LAYOUT
SCALE 1:50

TYPICAL

Aug 15/18 12:30pm
AutoCAD drawing: WSP-042.dwg

GO TRANSIT PROJECT NO. XXXXX

REFERENCE DRAWINGS		ISSUE		REVISIONS		
DWG. NO.	TITLE	REV.	DATE	ISSUED FOR	REV.	DATE

DRAWN BY:	DESIGNED BY:
CHECKED BY:	APPROVED BY:
SCALE: 1:50 FULL SIZE ONLY	



XXXXXX WAYSIDE POWER SUBSTATION BUILDING GENERAL POWER LAYOUT			
CONTRACT NO. XXXXXXXXXXXX	DWG. NO. WSP-042	REV. 0	SHEET XX