


PLUG PIN CONTACT JUMPER

CLEMENTS NATIONAL COMPANY
CAT.#CN-GTPC10-14m
NOTE 2

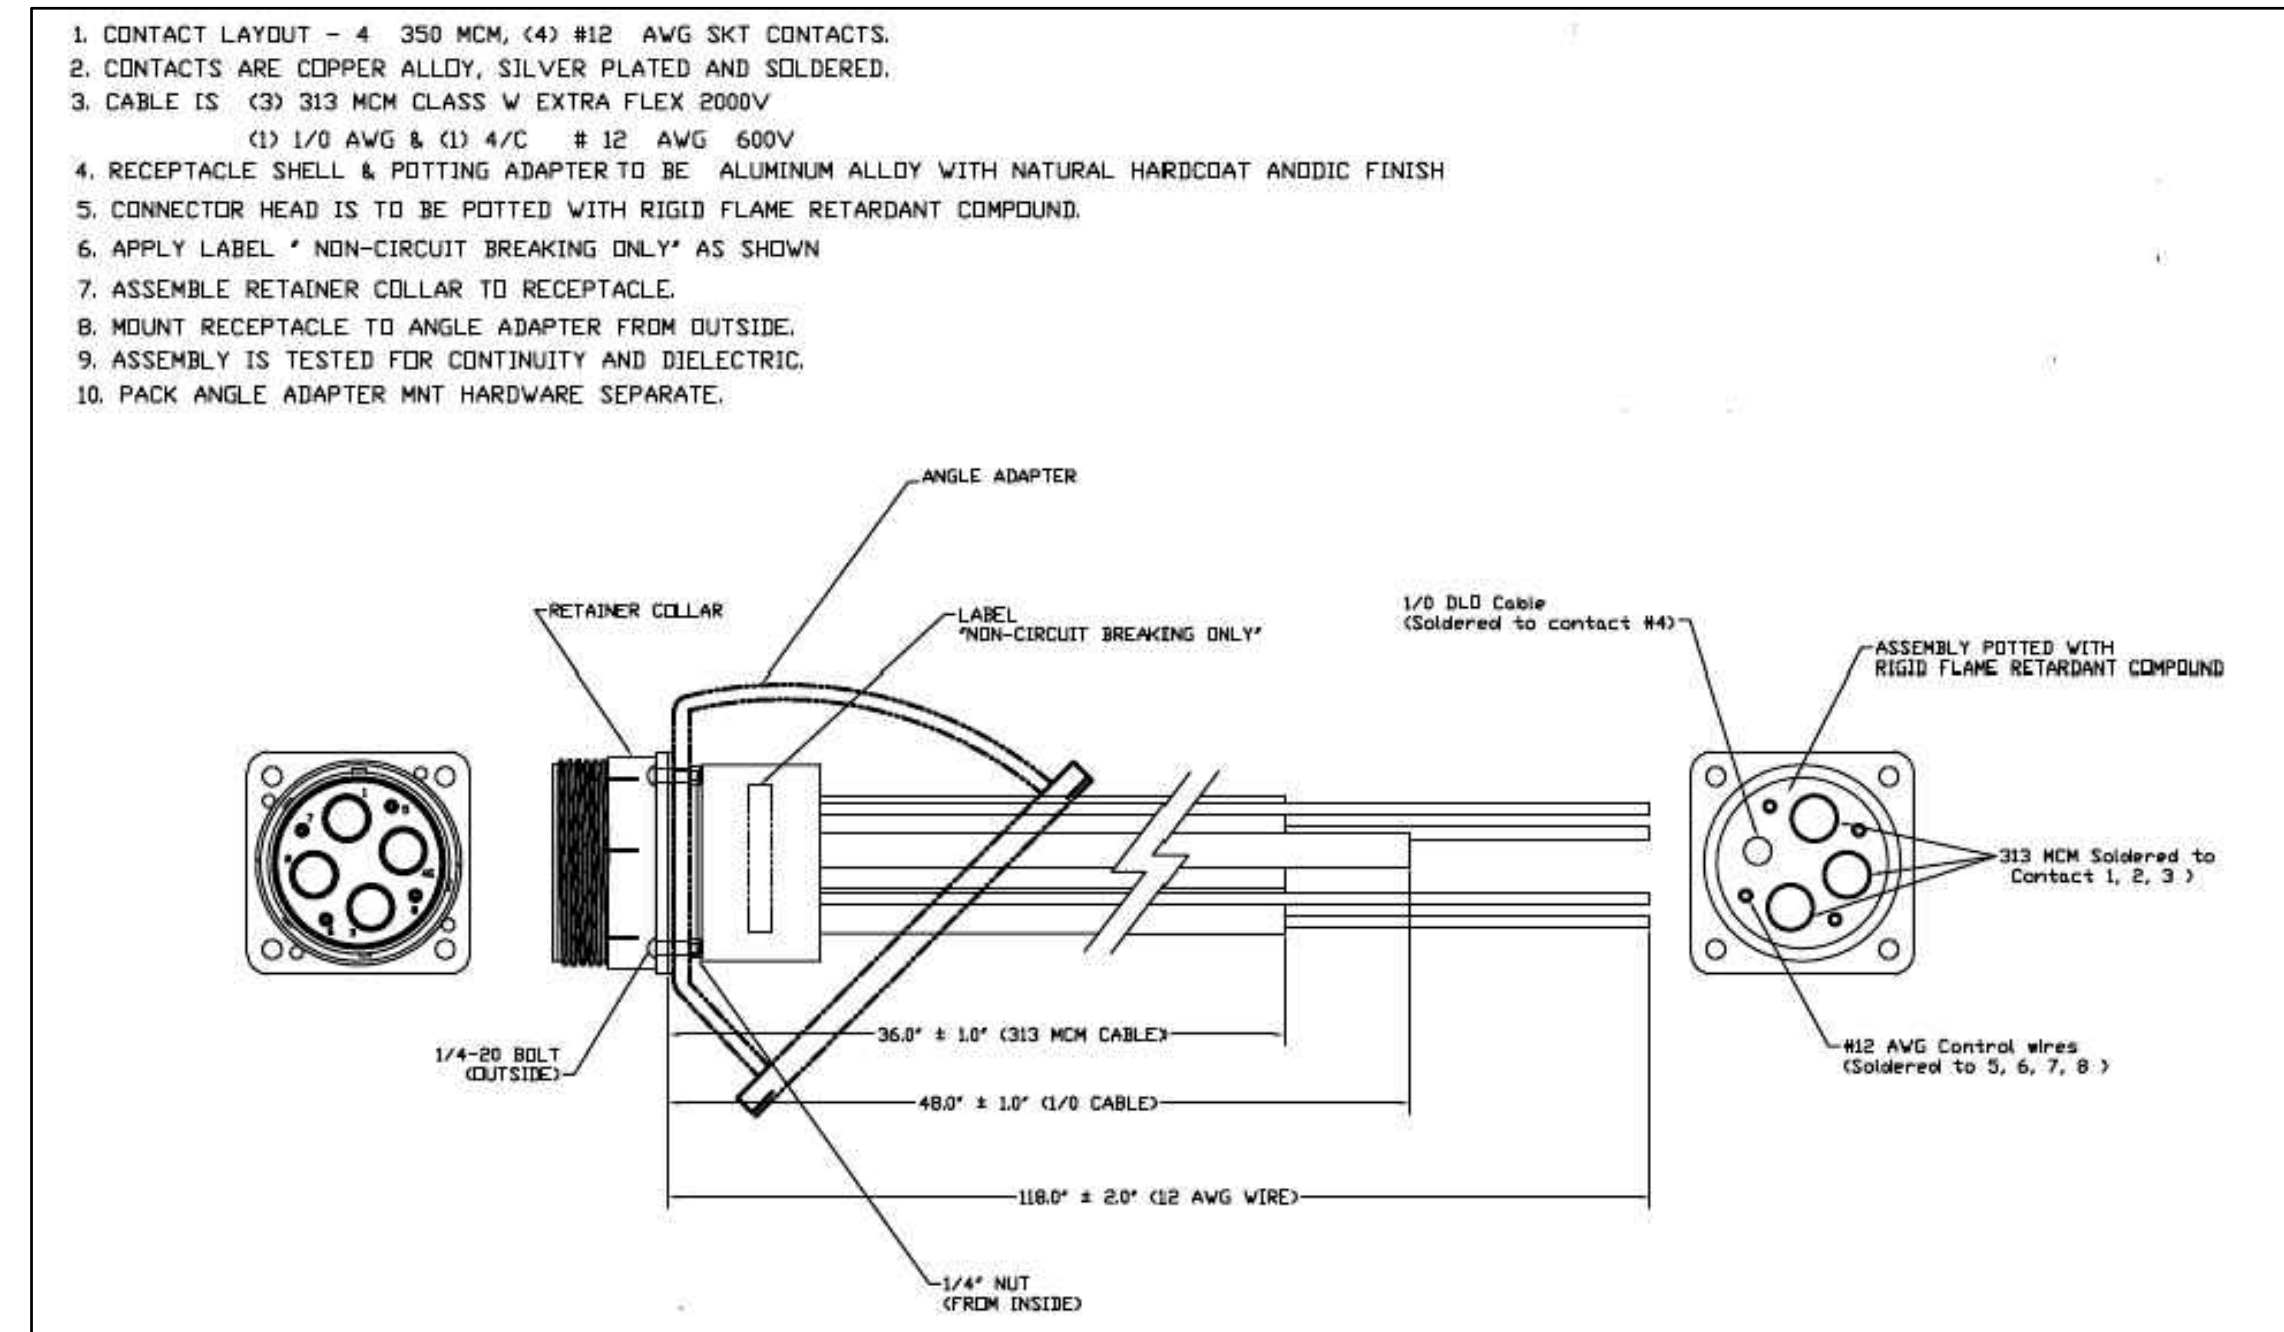

RECEPTACLE ASSEMBLY

CLEMENTS NATIONAL COMPANY
CAT.#CN-GTPC17-VXXX-V01

NOTES:

1. TRAIN CABLES TO BE SUPPLIED BY OWNER AND INSTALLED UNDER THIS CONTRACT. SET OF FOUR TRAIN CABLES PER WAYSIDE CABINET.
2. TRAIN CABLE LENGTH IS A ROUGH APPROXIMATION. DETERMINE CABLE LENGTH BASED ON CONTRACTOR'S SITE MEASUREMENTS.
3. DETAILS ARE TYPICAL ONLY.
4. REFER TO ELECTRIFICATION STANDARDS AND SPECIFICATIONS FOR GROUNDING AND BONDING, EMI/EMF WITHSTAND REQUIREMENTS, CABLING REQUIREMENTS

NOTE:
THIS DRAWING IS TO BE USED ONLY AS A REFERENCE DRAWING FOR EXISTING INSTALLATIONS AND EXPANSION OF EXISTING EQUIPMENT AS NECESSARY. NOT TO BE USED IN NEW DESIGNS.

NOTE:
THIS DRAWING IS PROVIDED FOR INSTRUCTIONAL DESIGN PURPOSES ONLY BASED ON METROLINX GO TRANSIT DESIGN GUIDELINES AND REQUIREMENTS. THE CONSULTANT SHALL VERIFY FOR LOCAL CODE COMPLIANCE, EXISTING SITE CONDITIONS AND INTER DISCIPLINARY DRAWING COORDINATION. ALL DIMENSIONS AND SPECIFICATIONS SHOULD BE VERIFIED BY CONSULTANT AND/OR CONTRACTOR BEFORE ACTUAL CONSTRUCTION BEGINS.

GO TRANSIT PROJECT NO. XX

REFERENCE DRAWINGS		ISSUE		REVISIONS		DRAWN BY: XX XX	DESIGNED BY: XX XX		XXXXXX WAYSIDE POWER DETAILS		CONTRACT NO. XX	DWG. NO. WSP-140	REV. 0	SHEET XX XX
						CHECKED BY: XX XX	APPROVED BY: XX XX							
						SCALE: N.T.S. FULL SIZE ONLY								
DWG. NO.	TITLE	REV.	DATE	ISSUED FOR	REV.	DATE								