
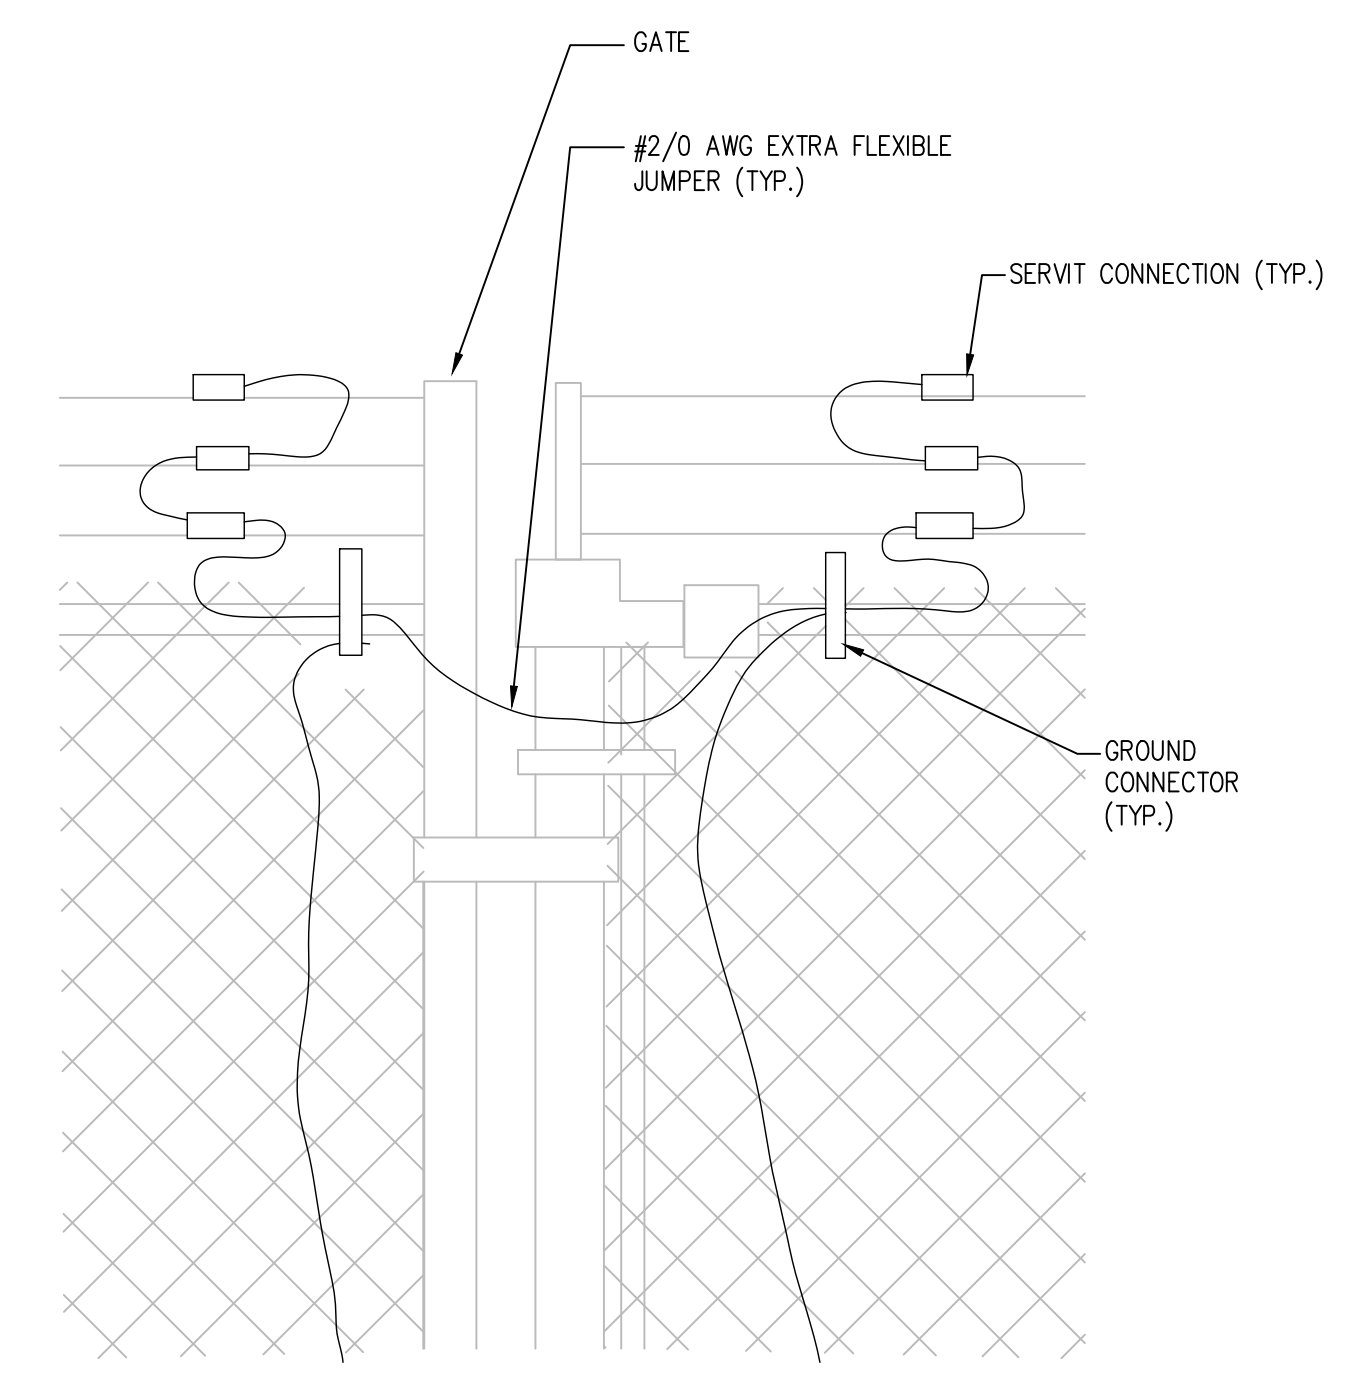


ALL DIMENSIONS SHOWN ARE IN METRES AND/OR MILLIMETRES UNLESS OTHERWISE NOTED.

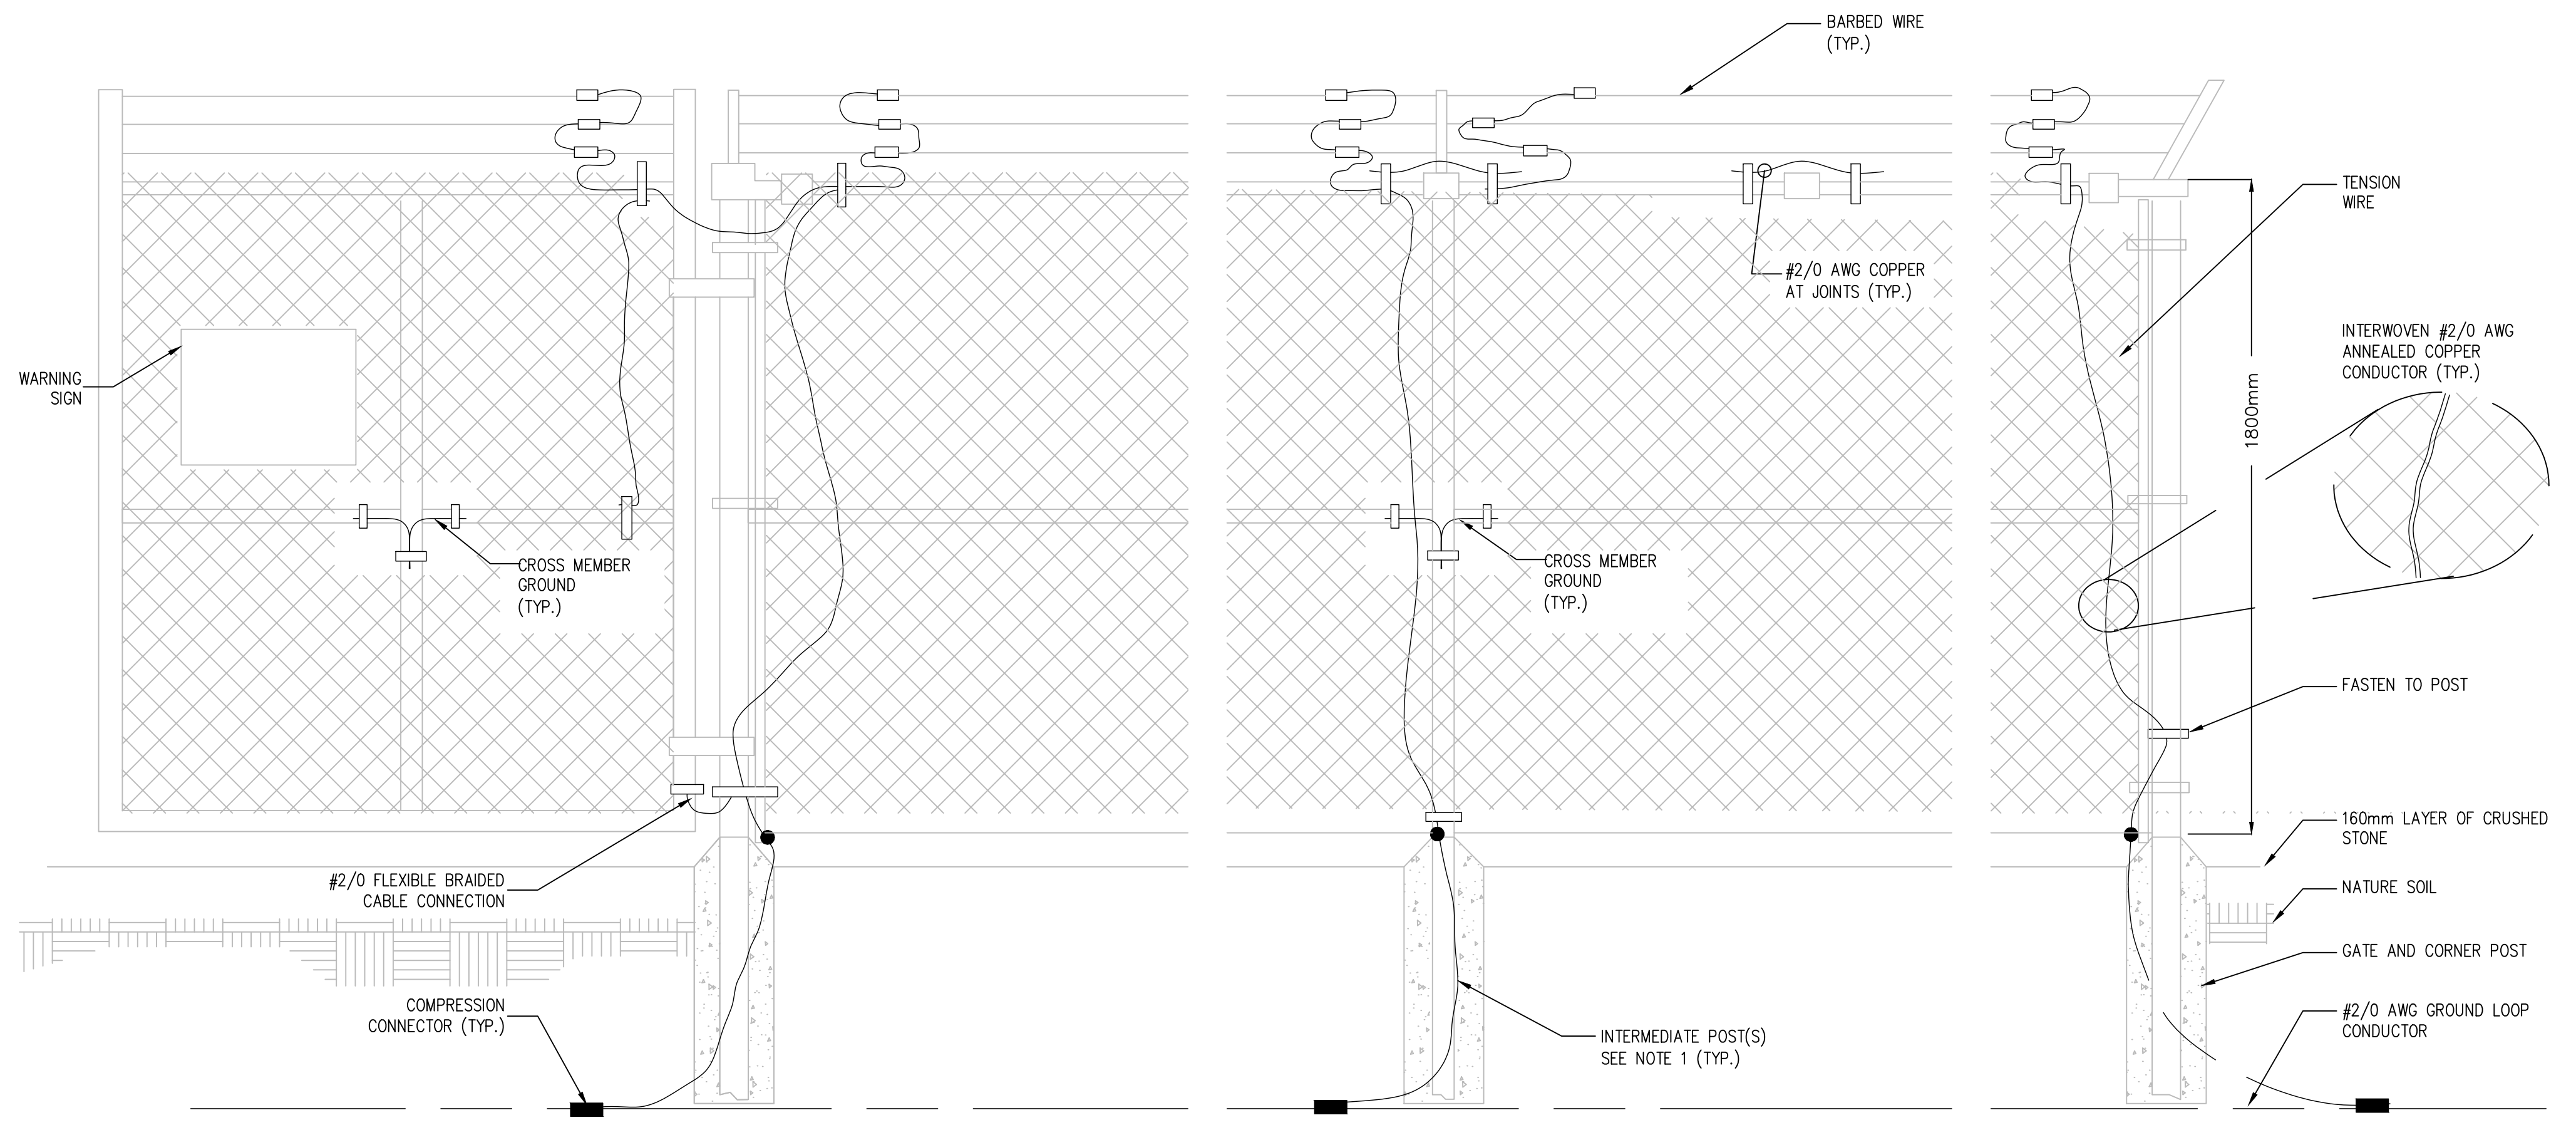

1 FENCE GROUNDING DETAIL
WSP-139 N.T.S.

2 GATE GROUNDING DETAIL
WSP-139 N.T.S.

NOTES:

- GROUND EVERY THIRD POST.
- REFER TO ELECTRIFICATION STANDARDS AND SPECIFICATIONS FOR GROUNDING AND BONDING, EMI/EMF WITHSTAND REQUIREMENTS, CABLING REQUIREMENTS

NOTE:
THIS DRAWING IS TO BE USED ONLY AS A REFERENCE DRAWING FOR EXISTING INSTALLATIONS AND EXPANSION OF EXISTING EQUIPMENT AS NECESSARY. NOT TO BE USED IN NEW DESIGNS.

NOTE:
THIS DRAWING IS PROVIDED FOR INSTRUCTIONAL DESIGN PURPOSES ONLY BASED ON METROLINX GO TRANSIT DESIGN GUIDELINES AND REQUIREMENTS. THE CONSULTANT SHALL VERIFY FOR LOCAL CODE COMPLIANCE, EXISTING SITE CONDITIONS AND INTER DISCIPLINARY DRAWING COORDINATION. ALL DIMENSIONS AND SPECIFICATIONS SHOULD BE VERIFIED BY CONSULTANT AND/OR CONTRACTOR BEFORE ACTUAL CONSTRUCTION BEGINS.

REFERENCE DRAWINGS		ISSUE		REVISIONS		DRAWN BY: XX XX	DESIGNED BY: XX XX		GO TRANSIT PROJECT NO. XX XXXXXX WAYSIDE POWER FENCE GROUNDING DETAILS		CONTRACT NO. XX	DWG. NO. WSP-139	REV. 0	SHEET XX XX
						CHECKED BY: XX XX	APPROVED BY: XX XX							
						SCALE: N.T.S. FULL SIZE ONLY								
DWG. NO.	TITLE	REV.	DATE	ISSUED FOR	REV.	DATE								