



ALL DIMENSIONS SHOWN ARE IN METRES AND/OR MILLIMETRES UNLESS OTHERWISE NOTED.

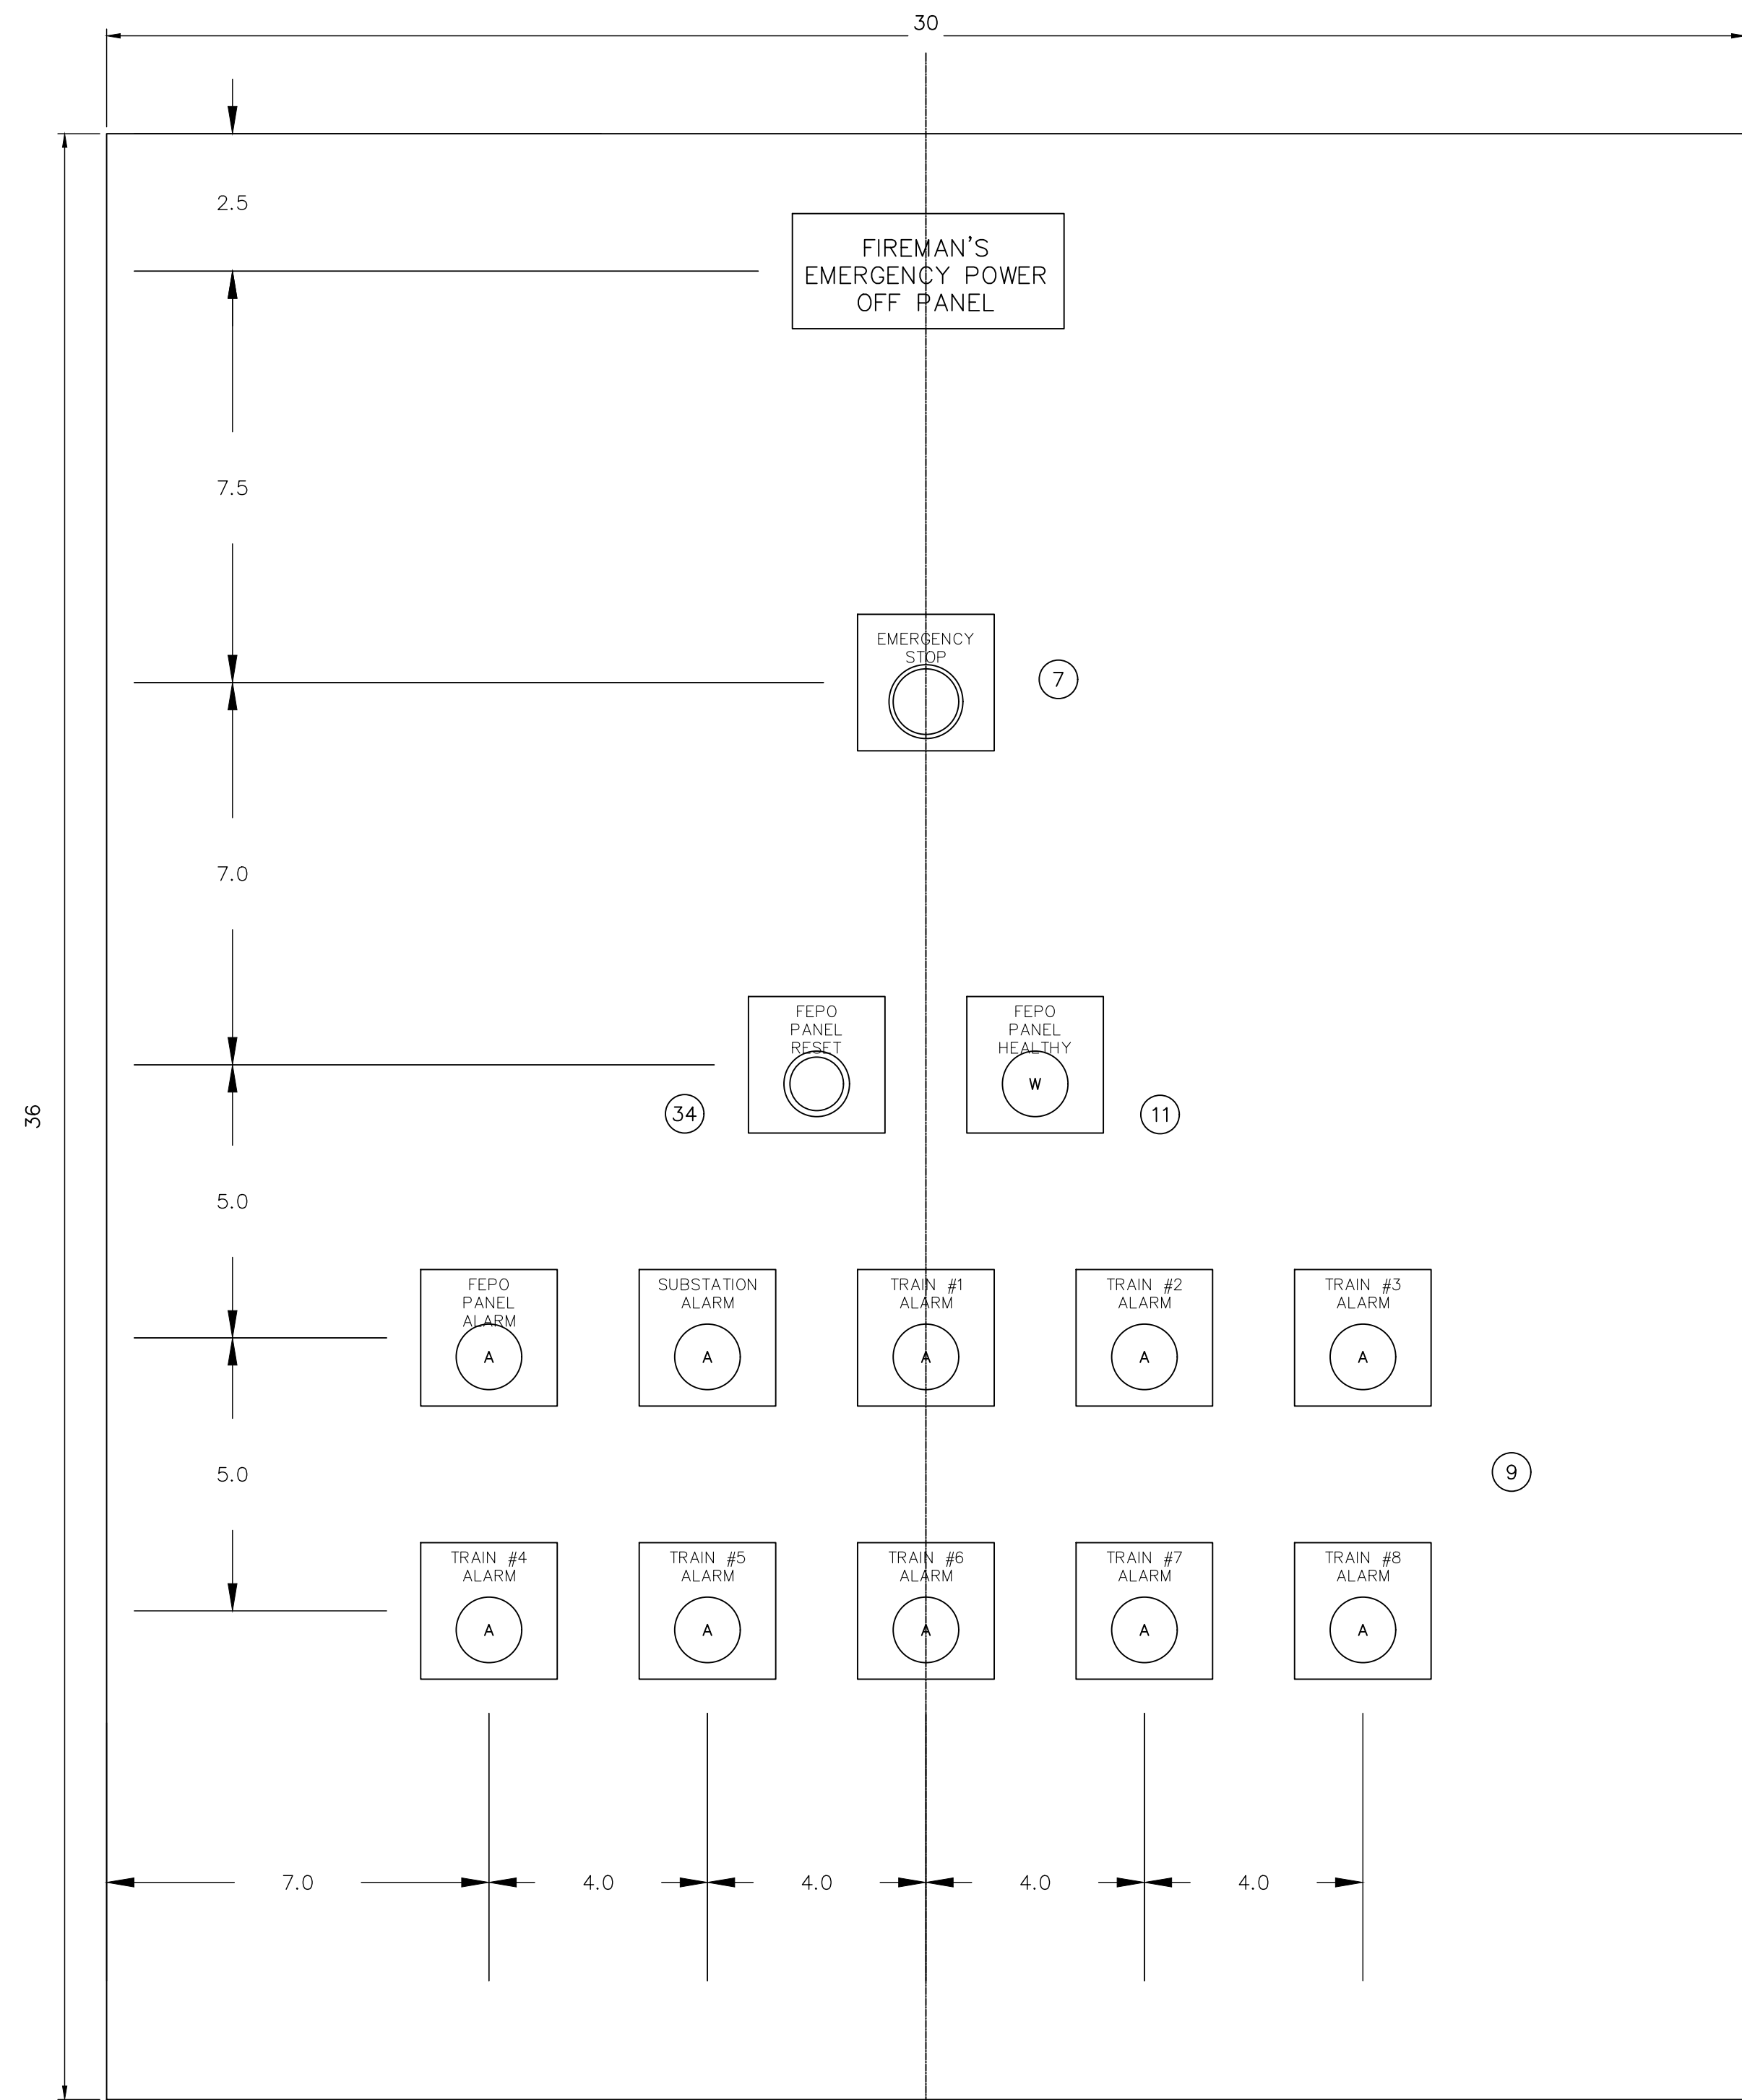

FRONT LAYOUT

(ALL DIMENSIONS ARE IN INCHES.)

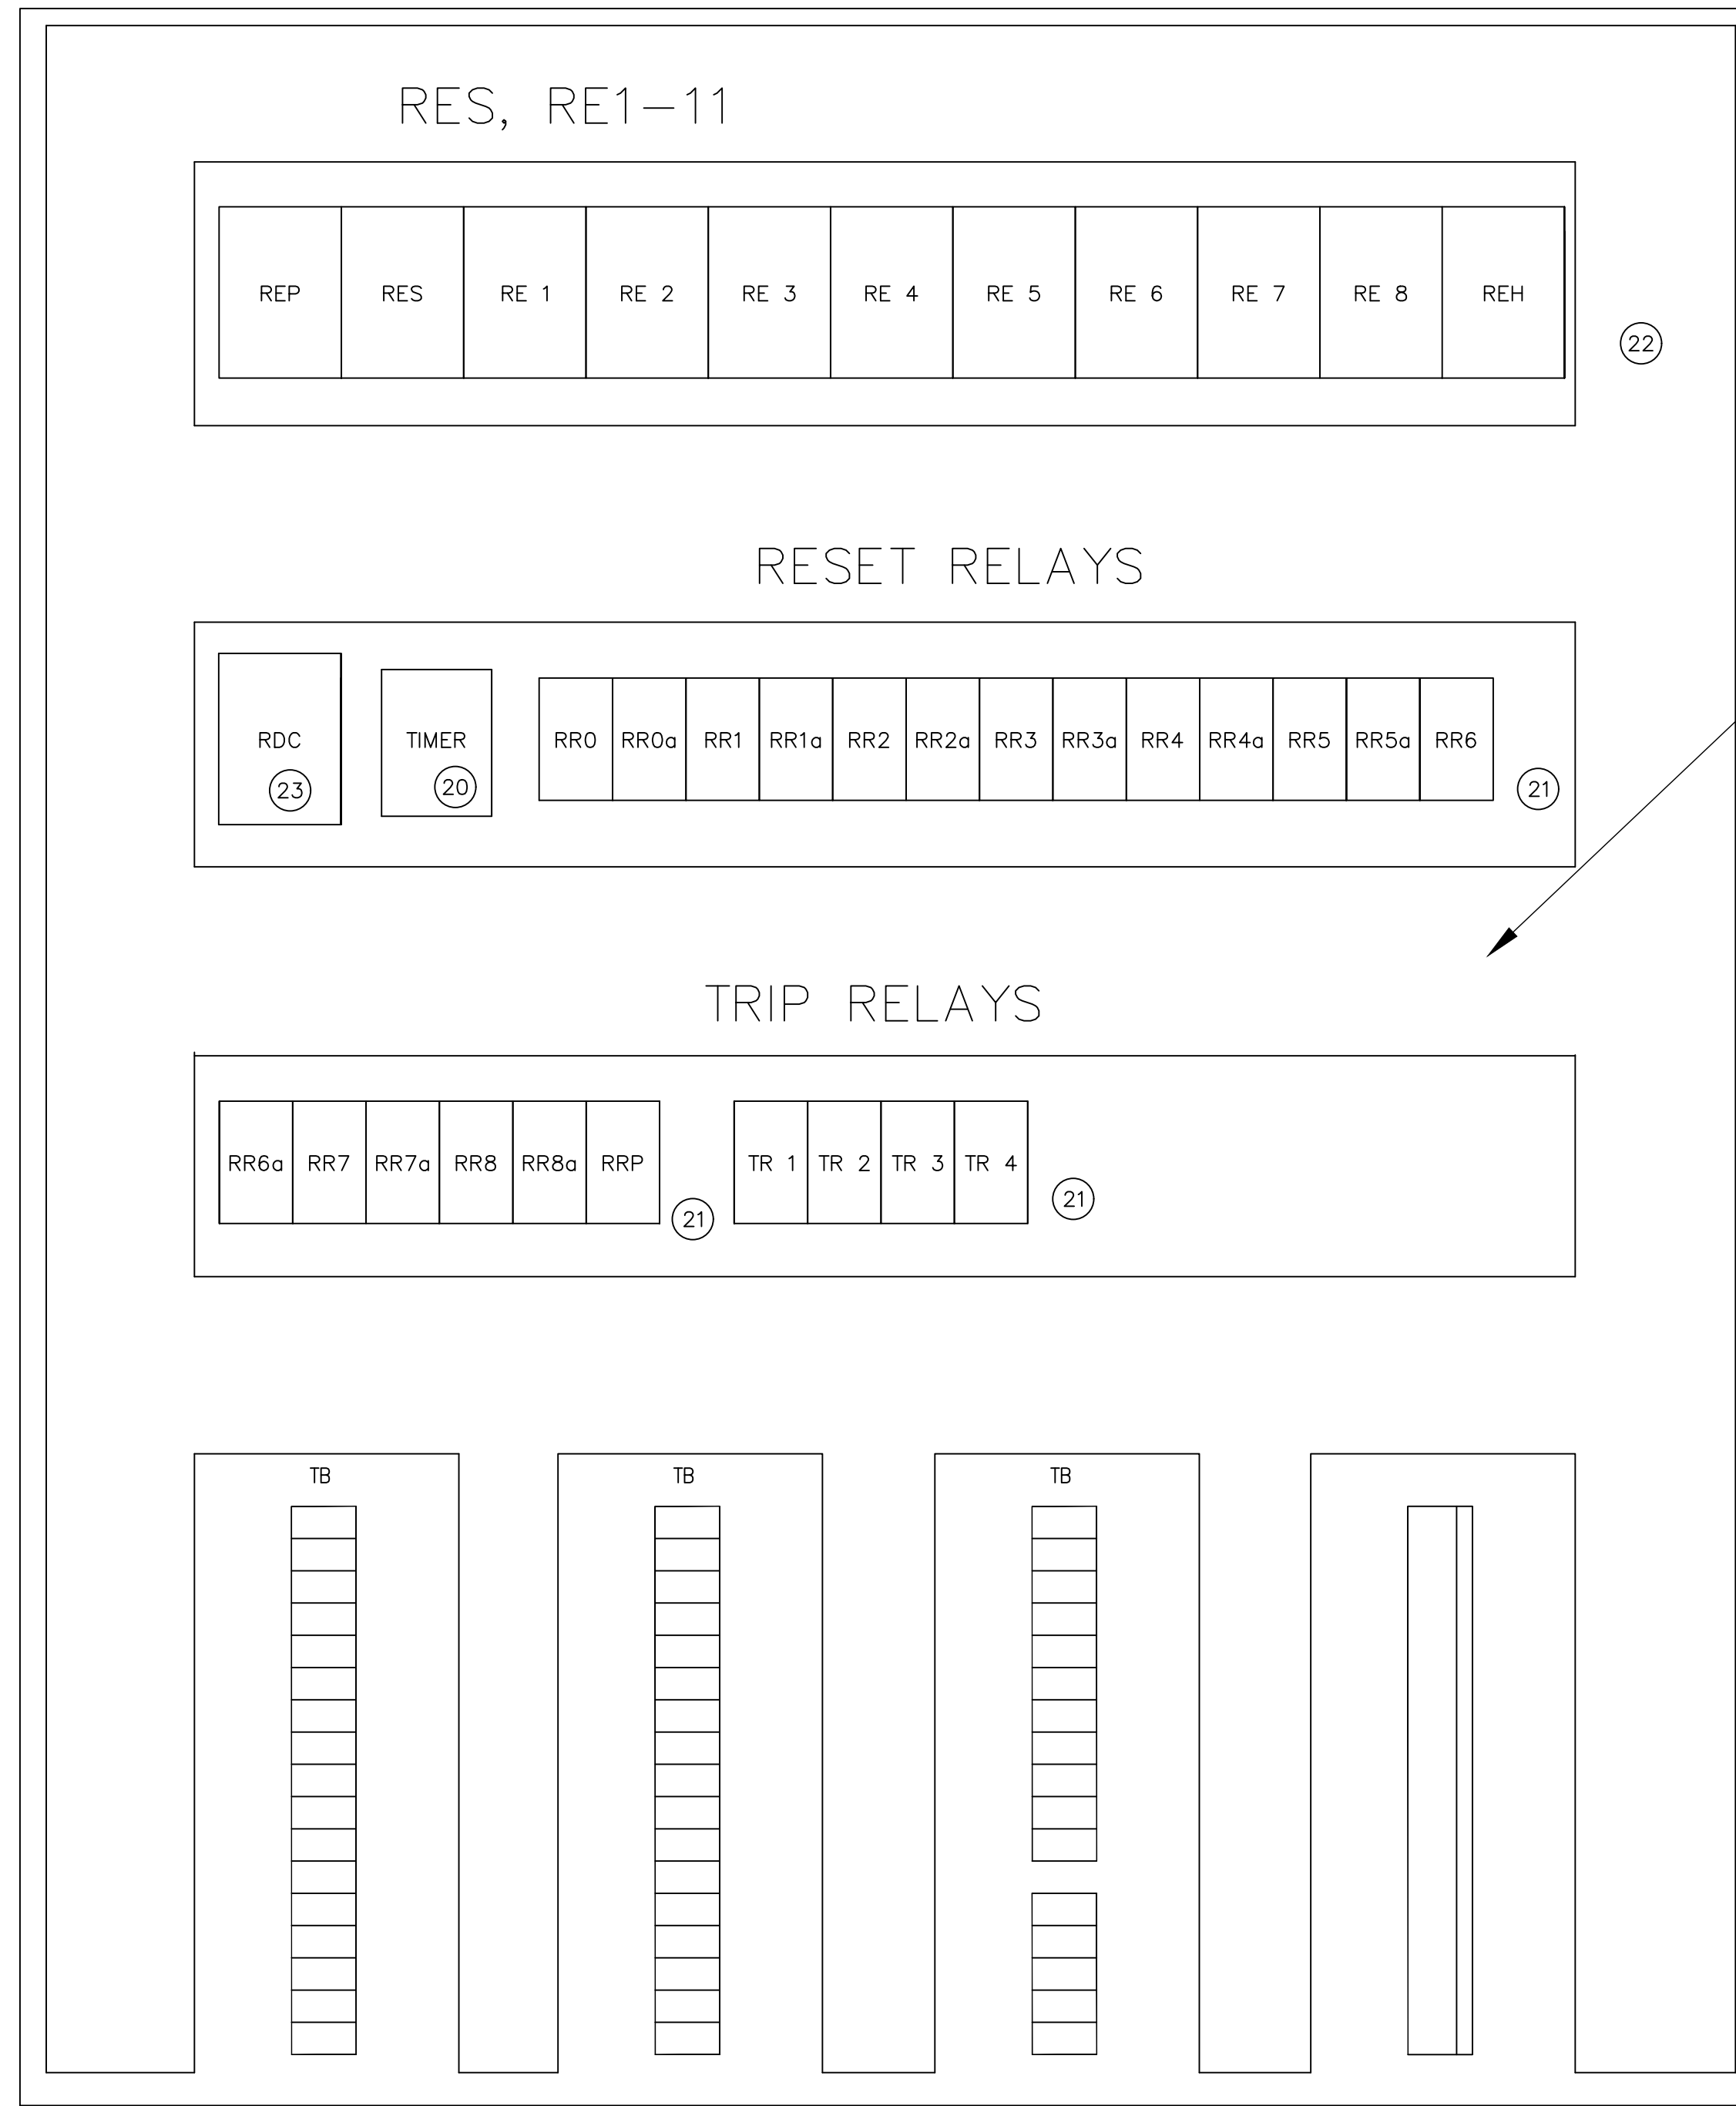

INSIDE LAYOUT

WIRE DUCTS

NOTES:

1. CONSULTANTS ARE TO REVIEW ALL WIRE SIZING TO TAKE INTO ACCOUNT; DERATING AND 3% MAXIMUM VOLTAGE DROP FACTORS. WIRE SIZES ARE SUGGESTIONS ONLY.
2. COMPONENT CROSS REFERENCES SHOWN AS: XXYY WHERE "XX" REPRESENTS FINAL 2 DIGITS OF REFERENCE DRAWING # AND "YY" REPRESENTS QUADRANT LOCATION ON DWG. I.E. 02C1 = WSP-002 QUAD. C1
3. REFER TO ELECTRIFICATION STANDARDS AND SPECIFICATIONS FOR GROUNDING AND BONDING, EMI/EMF WITHOUT REQUIREMENTS, CABLING REQUIREMENTS.

NOTE:  
THIS DRAWING IS TO BE USED ONLY AS A REFERENCE DRAWING FOR EXISTING INSTALLATIONS AND EXPANSION OF EXISTING EQUIPMENT AS NECESSARY. NOT TO BE USED IN NEW DESIGNS.

NOTE:  
THIS DRAWING IS PROVIDED FOR INSTRUCTIONAL DESIGN PURPOSES ONLY BASED ON METROLINX GO TRANSIT DESIGN GUIDELINES AND REQUIREMENTS. THE CONSULTANT SHALL VERIFY FOR LOCAL CODE COMPLIANCE, EXISTING SITE CONDITIONS AND INTER DISCIPLINARY DRAWING COORDINATION. ALL DIMENSIONS AND SPECIFICATIONS SHOULD BE VERIFIED BY CONSULTANT AND/OR CONTRACTOR BEFORE ACTUAL CONSTRUCTION BEGINS.

GO TRANSIT PROJECT NO. XX

REFERENCE DRAWINGS	ISSUE	REVISIONS	DRAWN BY:	DESIGNED BY:
			XX XX	XX XX
			CHECKED BY:	APPROVED BY:
			XX XX	XX XX
			SCALE: N.T.S.	FULL SIZE ONLY
DWG. NO.	TITLE	REV. DATE	ISSUED FOR	REV. DATE




XXXXXX  
WAYSIDE POWER  
FIREMAN EMERGENCY POWER OFF (FEPO) PANEL  
LAYOUT

CONTRACT NO. XX	DWG. NO. WSP-125	REV. 0	SHEET XX XX
--------------------	---------------------	-----------	----------------