
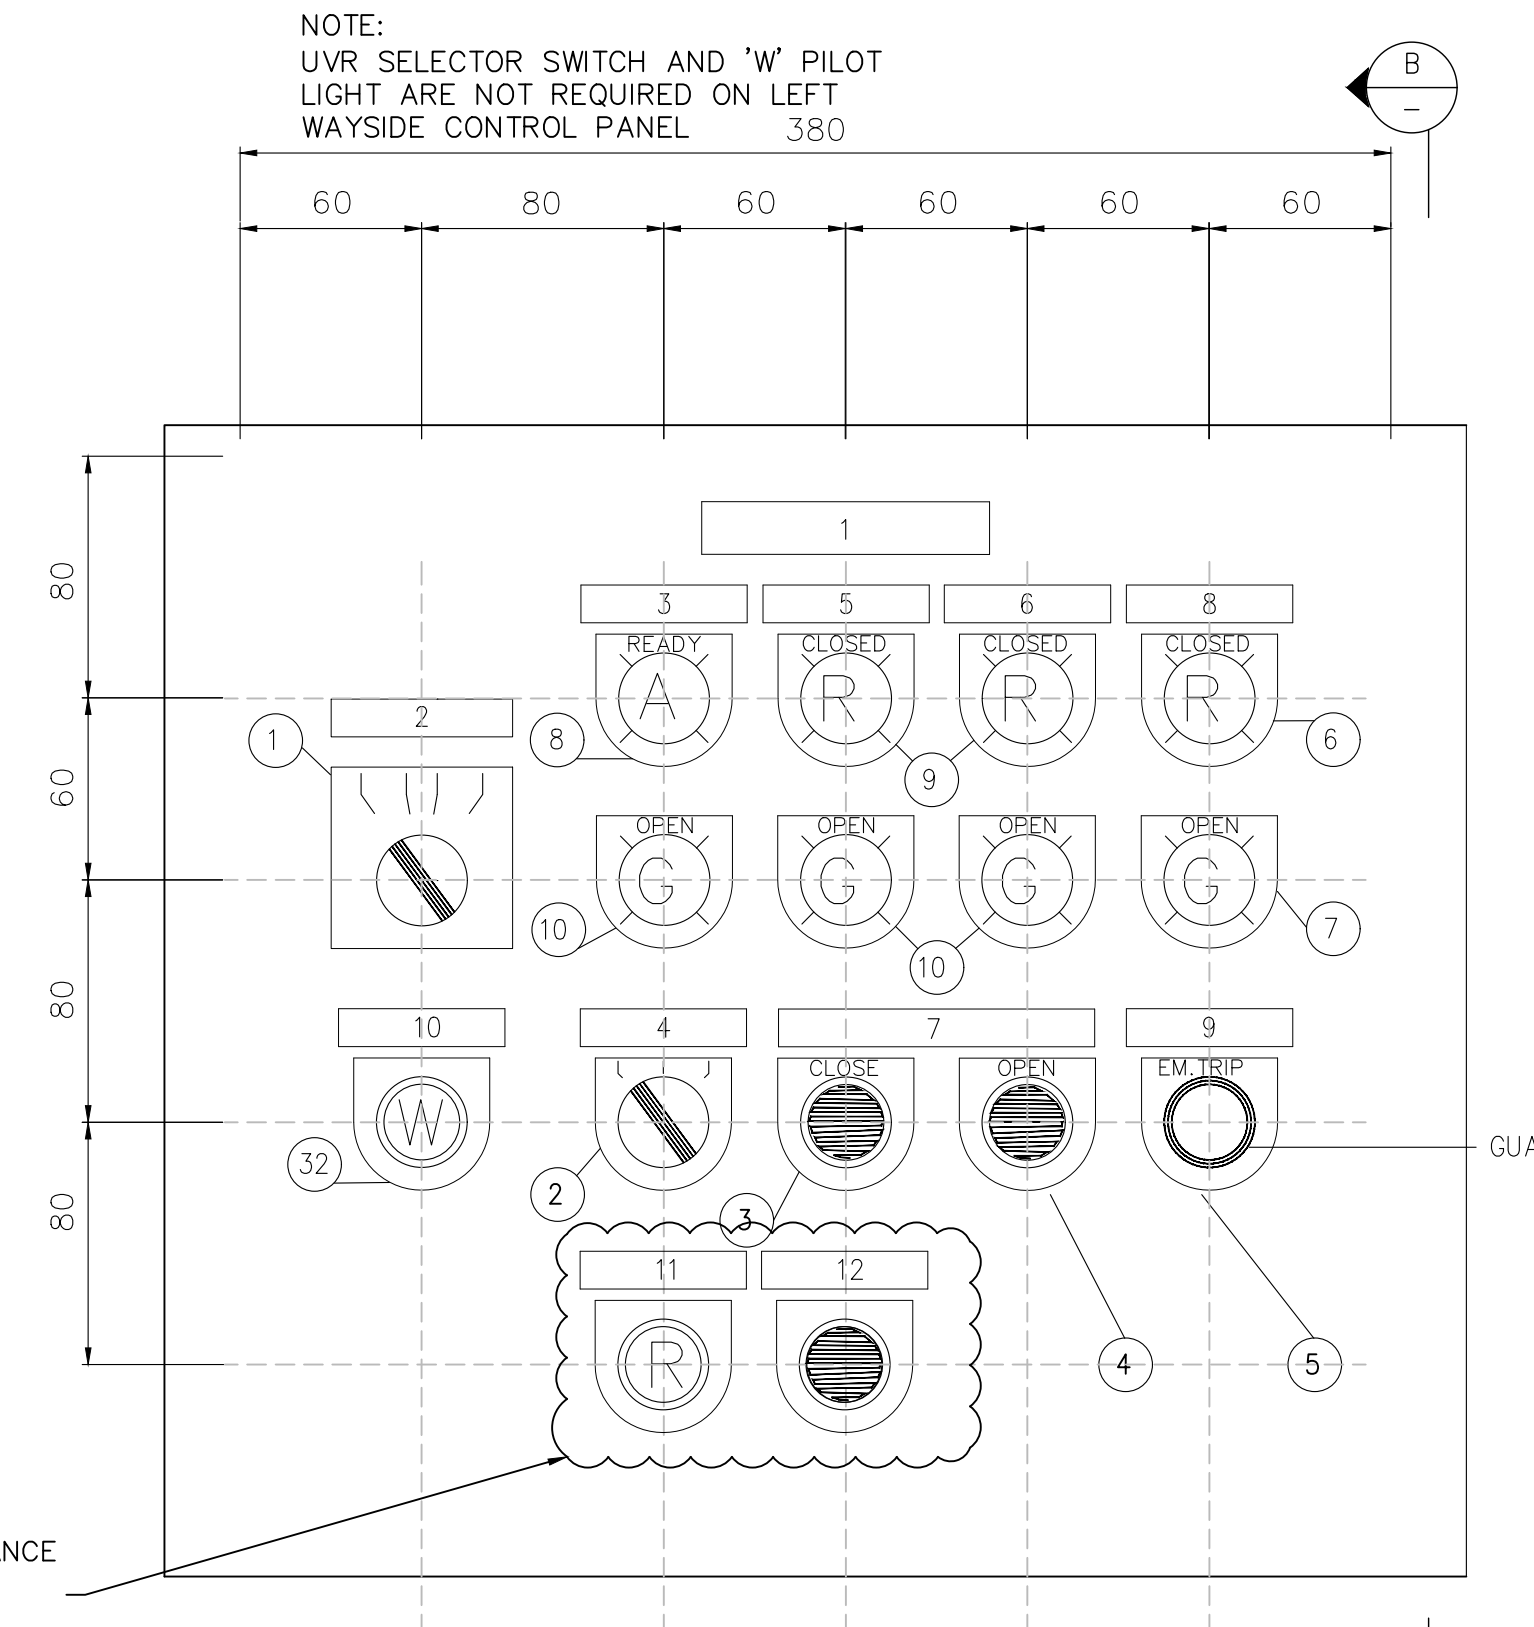







D SIZE 22" x 34" (558.8mm x 863.6mm)

METRIC

ALL DIMENSIONS SHOWN ARE IN METRES AND/OR MILLIMETRES UNLESS OTHERWISE NOTED.

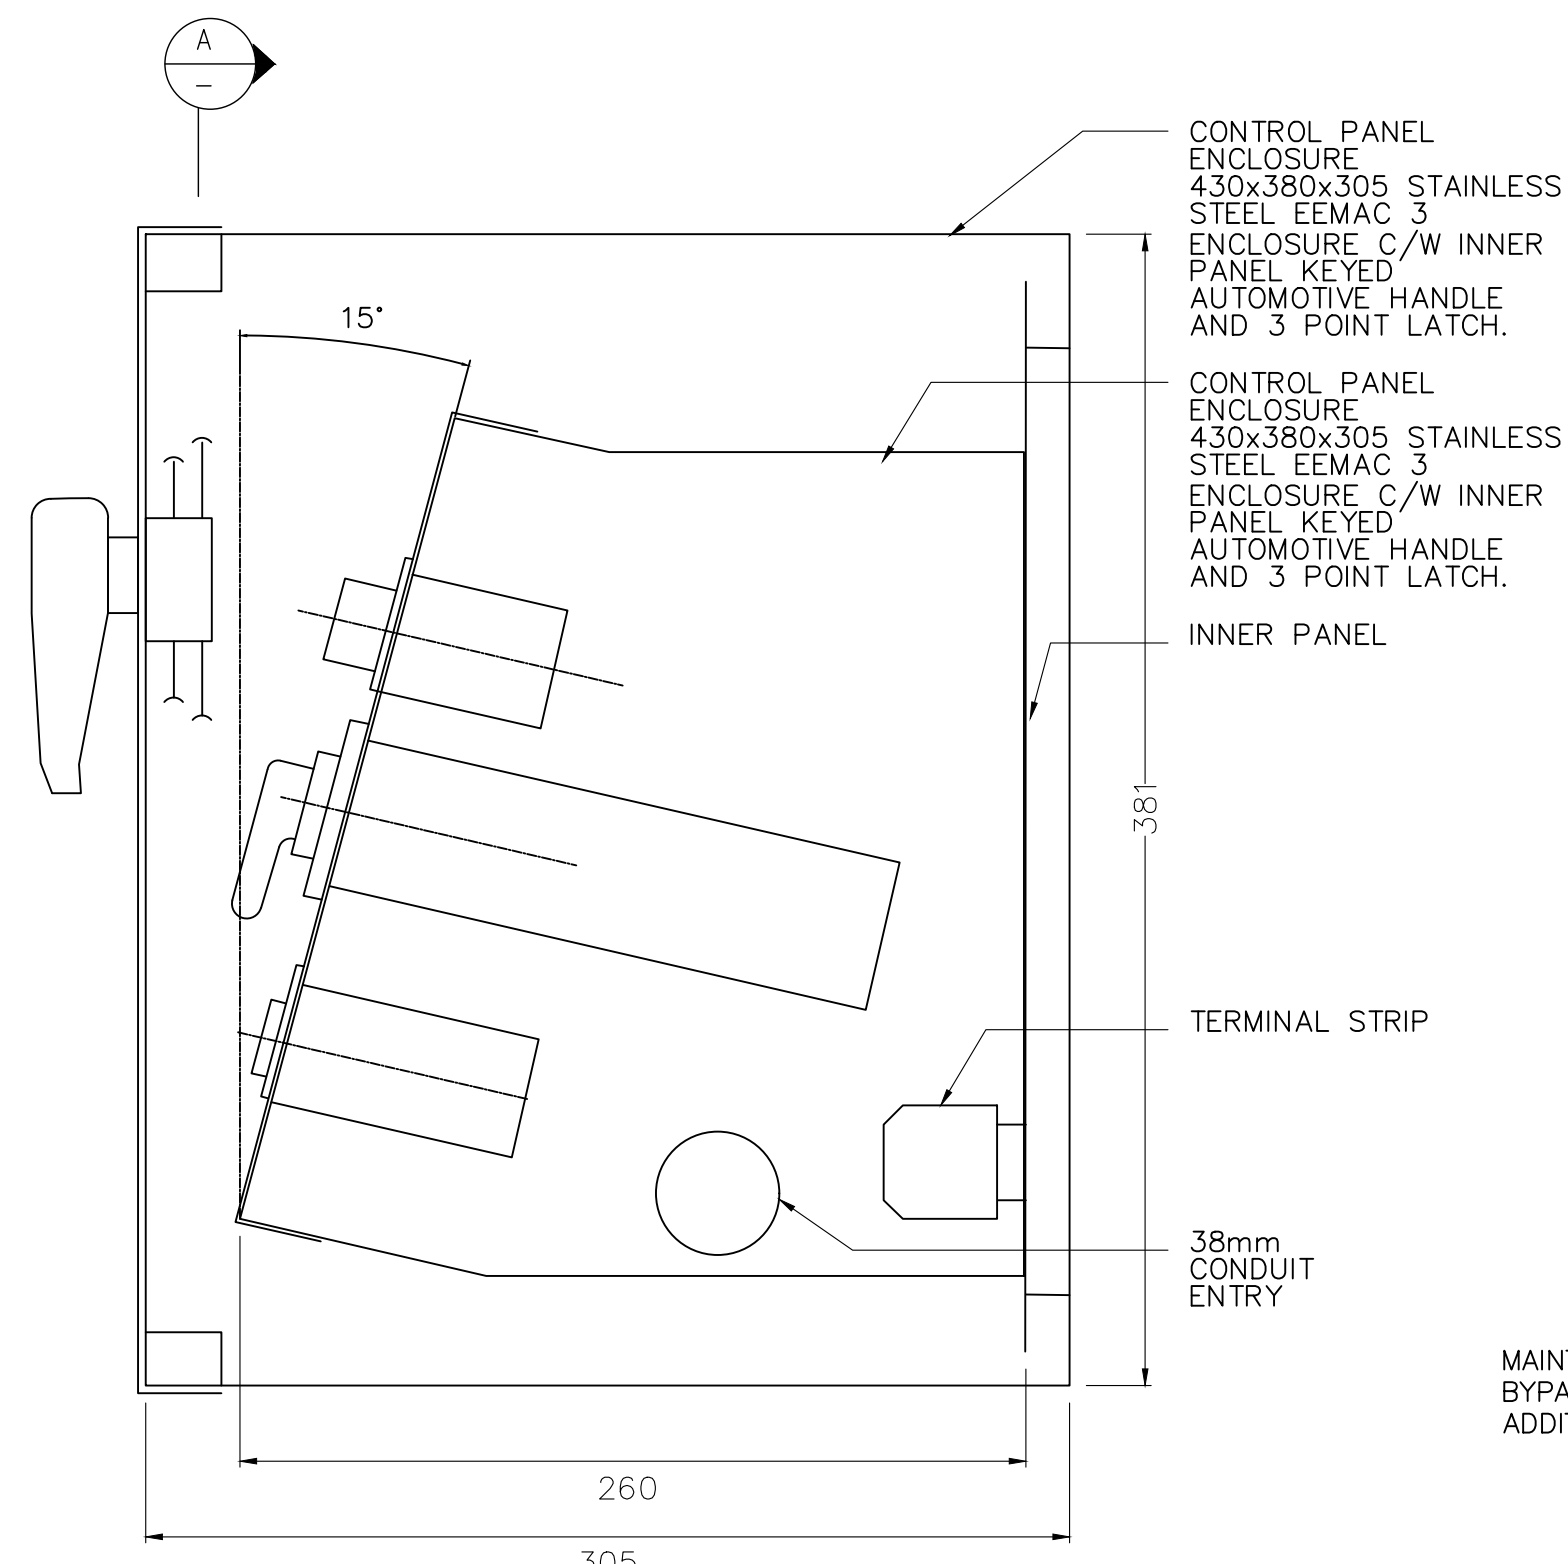

- NAME PLATE DATA**
1. TRACK No. 1 RIGHT
 2. UVR SELECTOR SSW-1U
 3. UVR LOOP
 4. CONTROL CONTROL POWER STATUS ON
 5. CONTACTOR No.1 (No.2 FOR LEFT SIDE)
 6. CONTACTOR No.3 (No.4 FOR LEFT SIDE)
 7. CONTACTOR No.1 & No.3 (No.2 & No.4 FOR LEFT SIDE)
 8. FEEDER BRKR No.FB-1 MAIN SWITCHGEAR
 9. FEEDER BRKR No.1 EM TRIP
 10. CABLE NOT CONNECTED PROPERLY
 11. MAINTENANCE BYPASS TIMER
 12. MAINTENANCE BYPASS

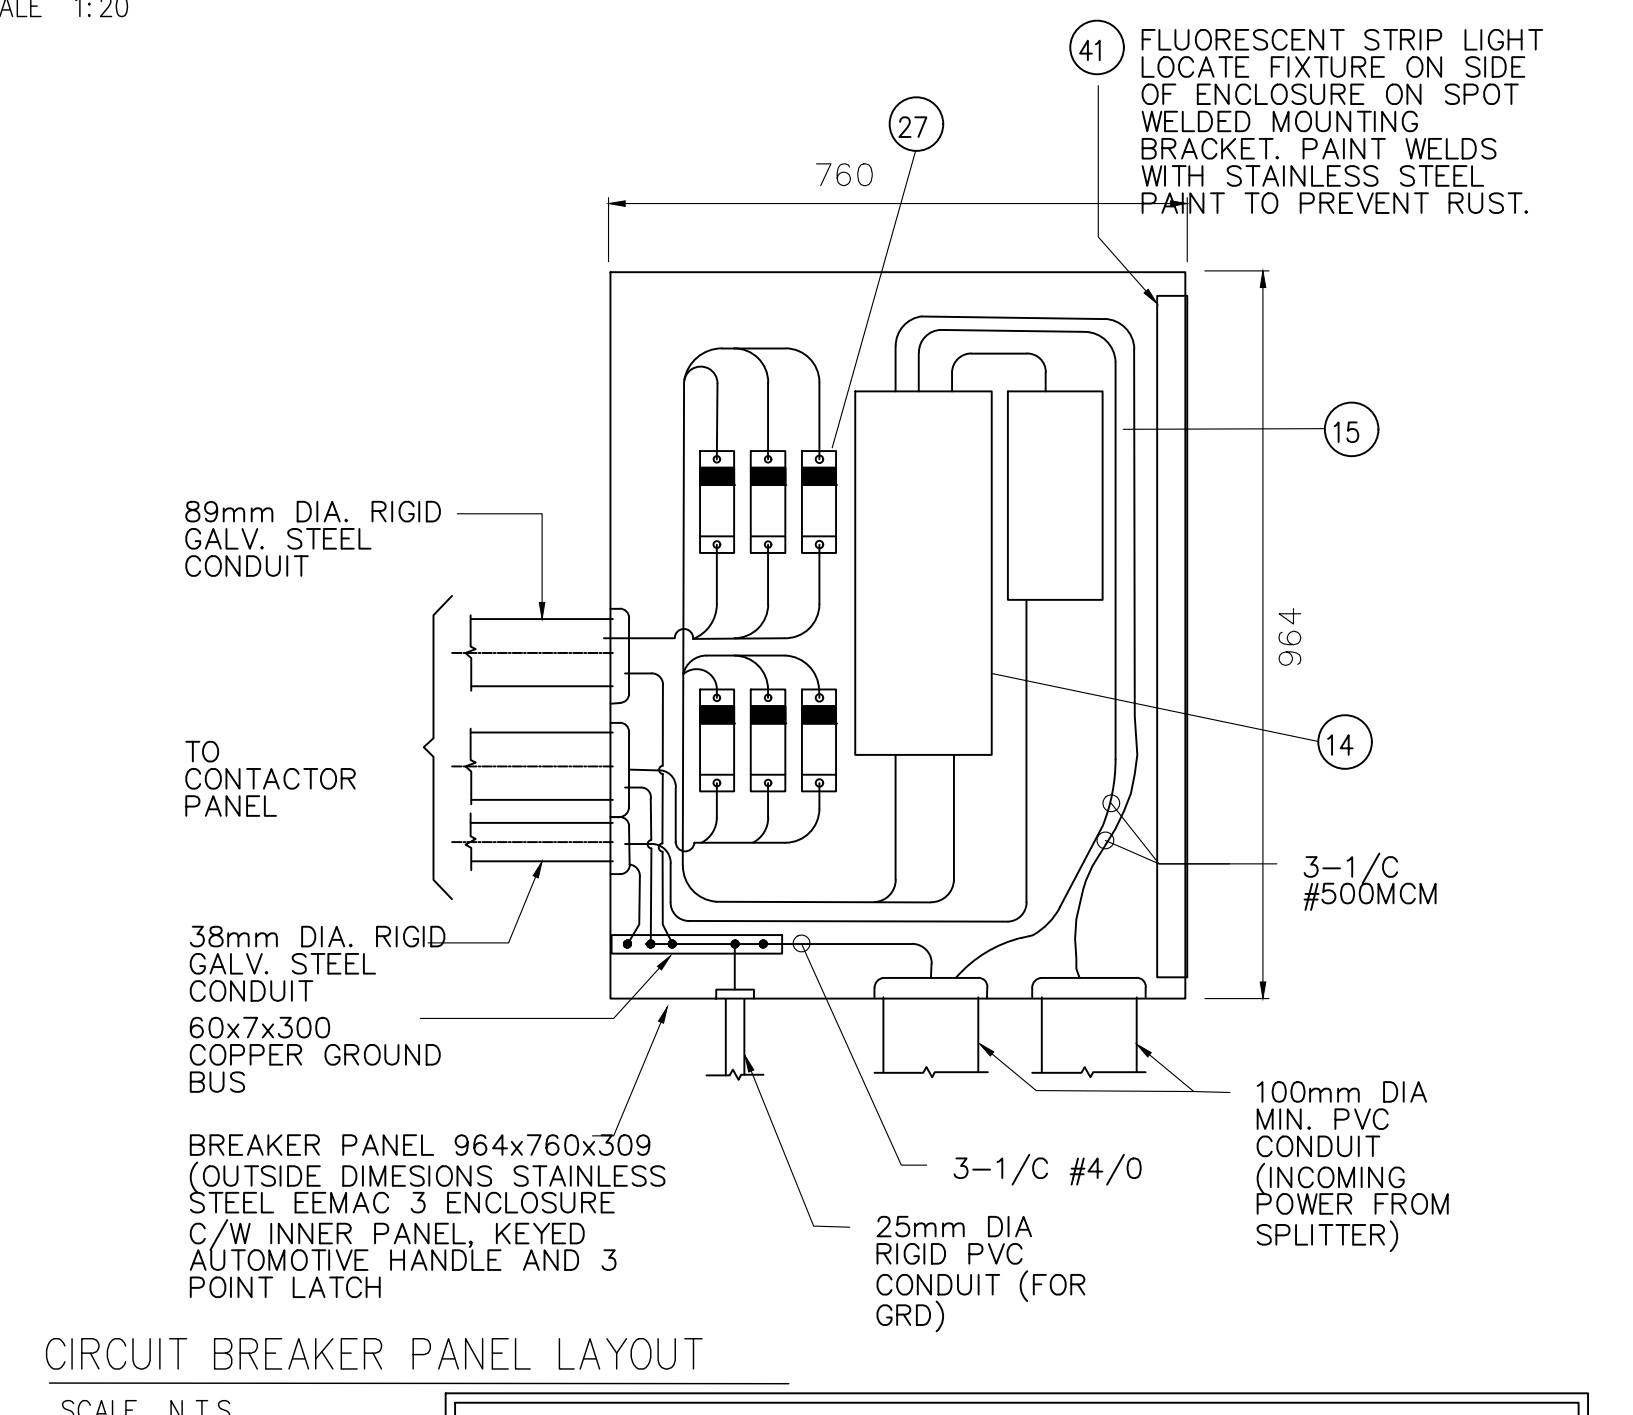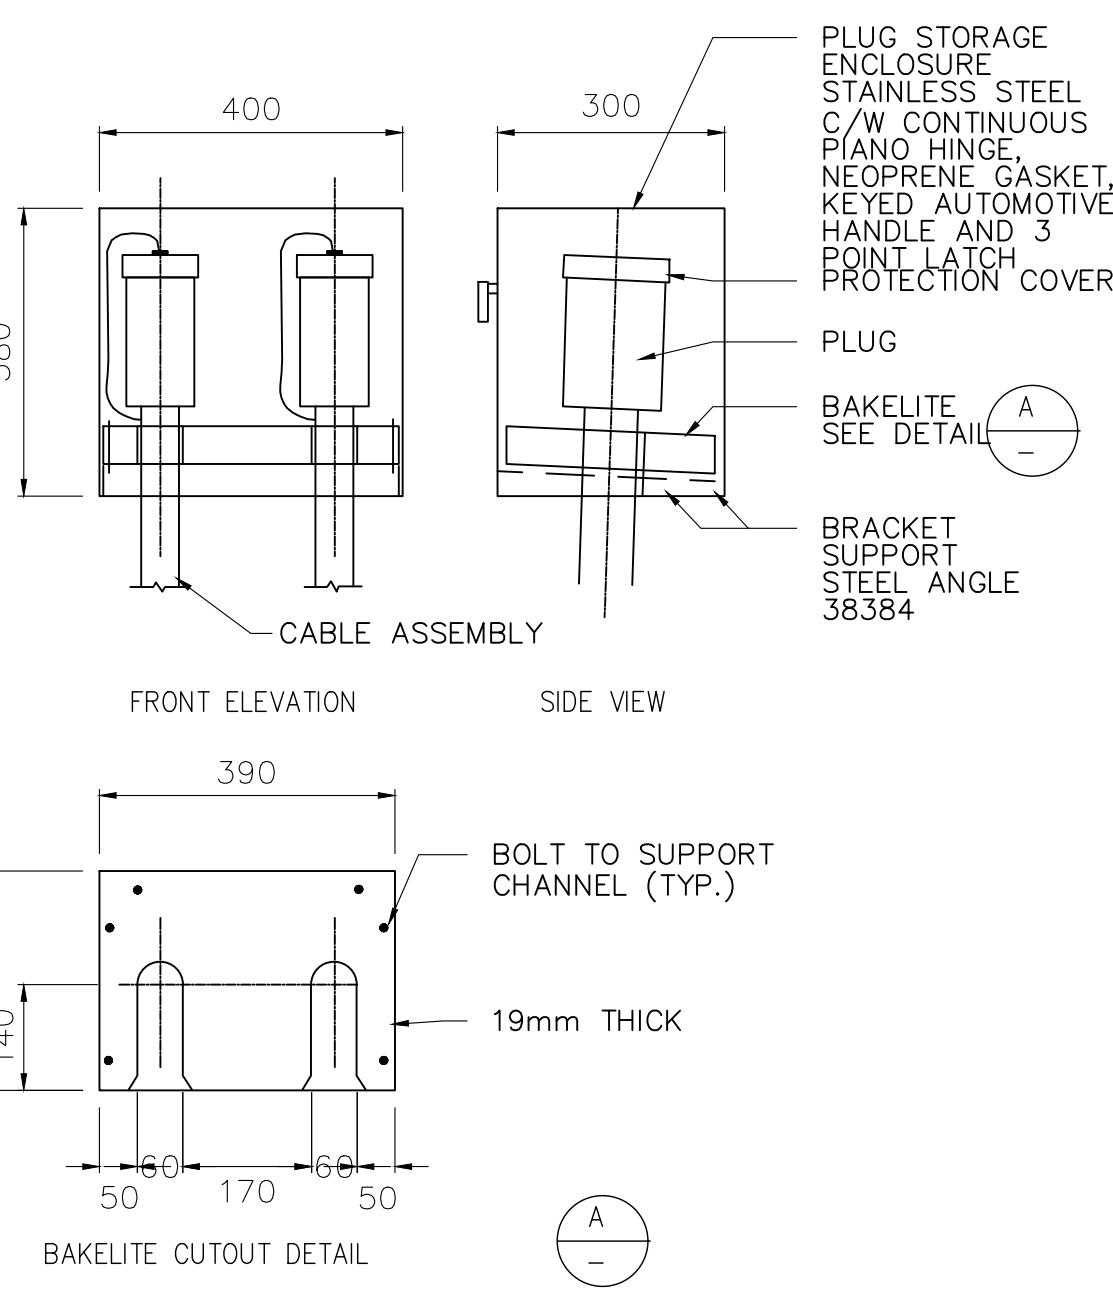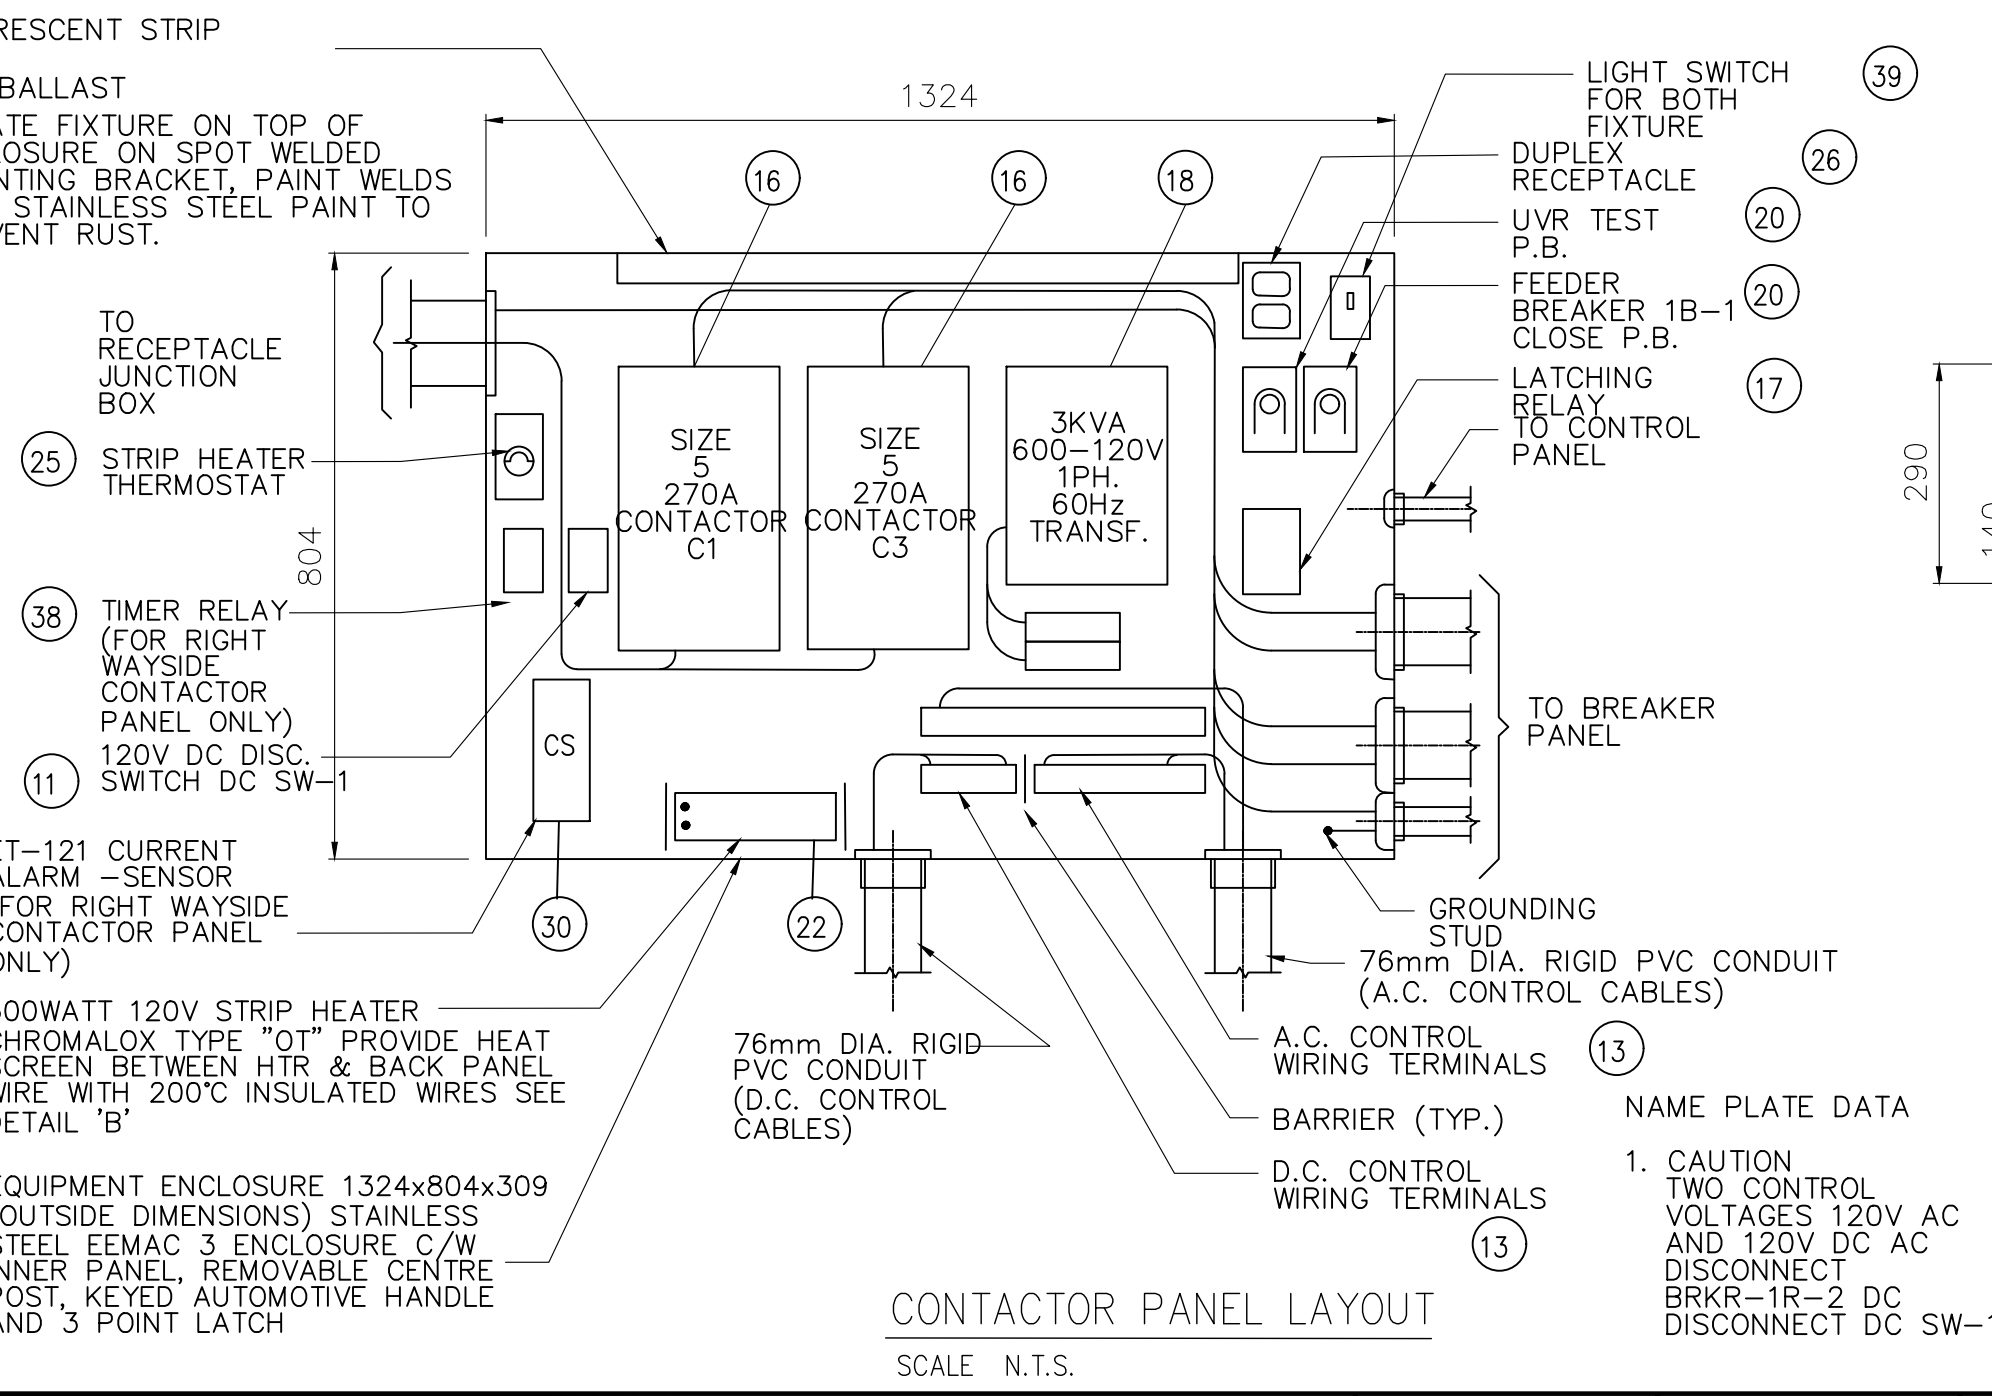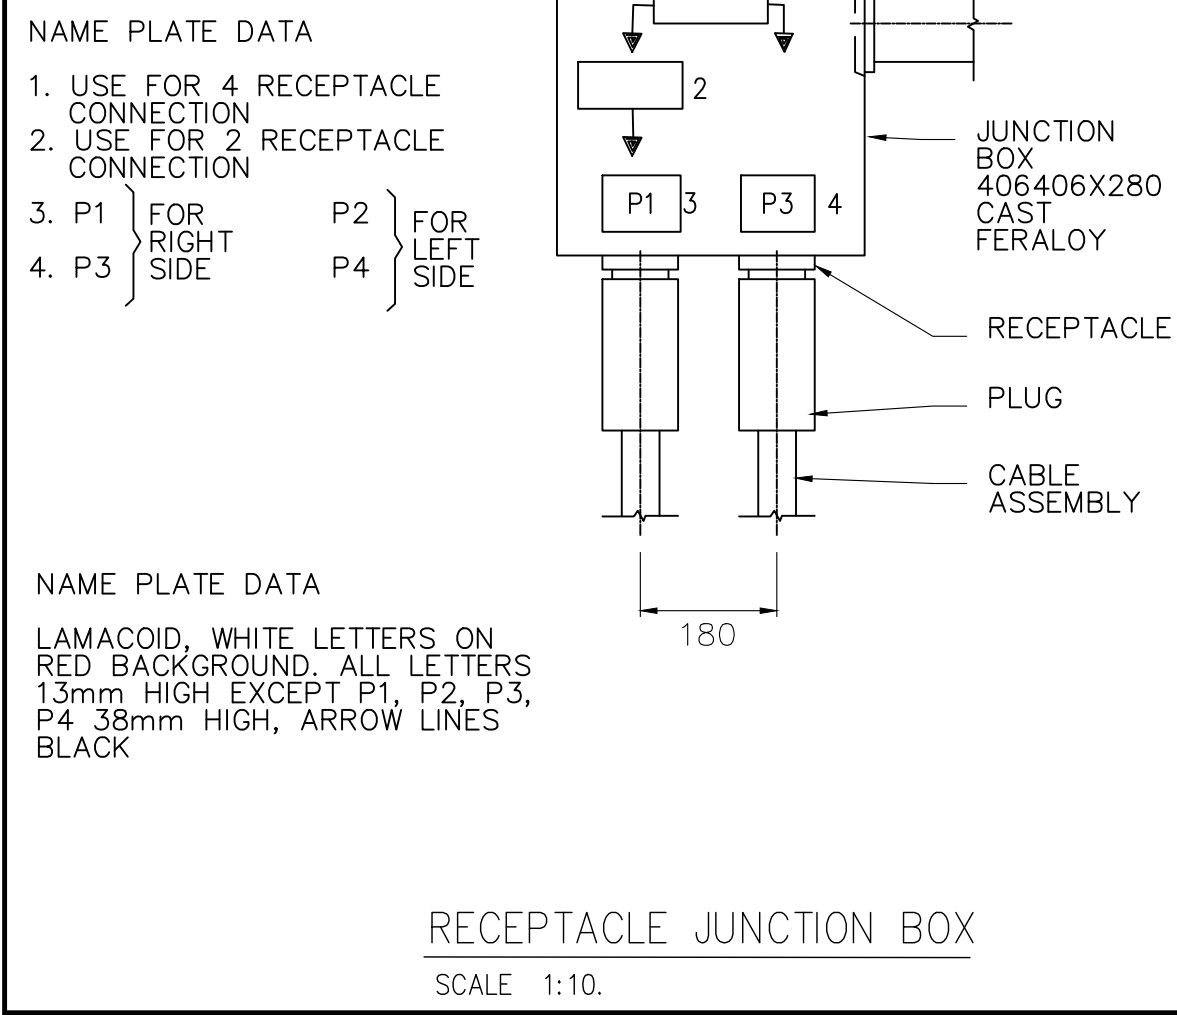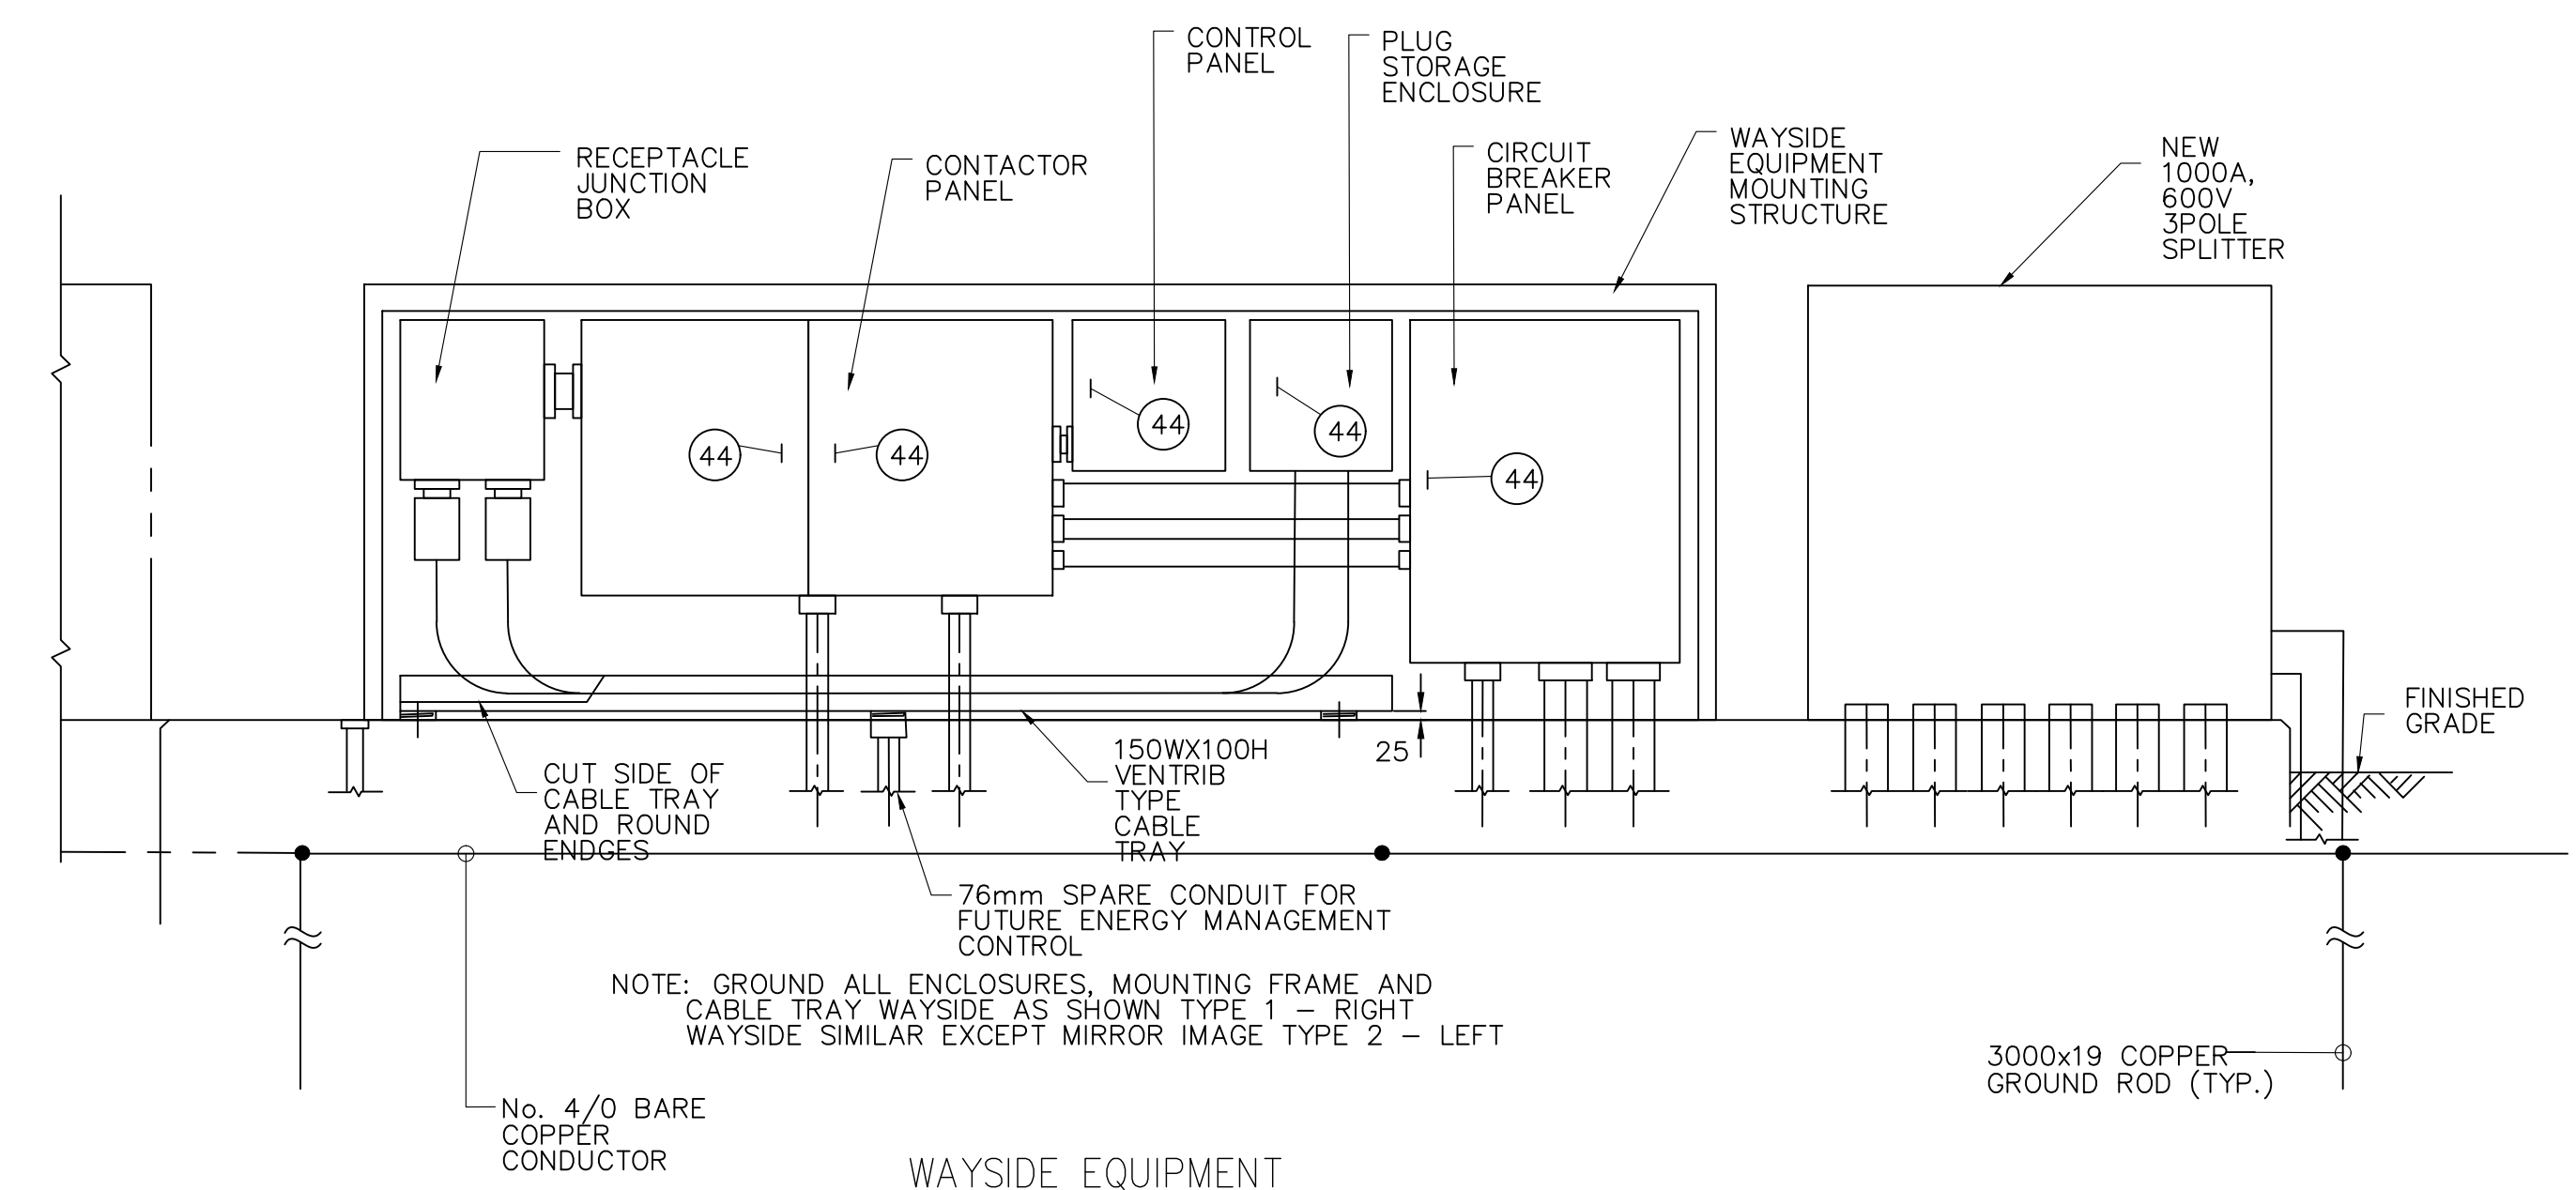


NOTES:

1. REFER TO ELECTRIFICATION STANDARDS AND SPECIFICATIONS FOR GROUNDING AND BONDING, EMI/EMF WITHSTAND REQUIREMENTS, CABLING REQUIREMENTS
2. PROVIDE NEW 1000A, 600V, 3 POLE SPLITTER IN NEW NEMA 4x CABINET. SPLITTER SHALL BE SUITABLE FOR 750kcmil CABLES.

NOTE: THIS DRAWING IS TO BE USED ONLY AS A REFERENCE DRAWING FOR EXISTING INSTALLATIONS AND EXPANSION OF EXISTING EQUIPMENT AS NECESSARY. NOT TO BE USED IN NEW DESIGNS.

NOTE: THIS DRAWING IS PROVIDED FOR INSTRUCTIONAL DESIGN PURPOSES ONLY BASED ON METROLINX GO TRANSIT DESIGN GUIDELINES AND REQUIREMENTS. THE CONSULTANT SHALL VERIFY FOR LOCAL CODE COMPLIANCE, EXISTING SITE CONDITIONS AND INTER DISCIPLINARY DRAWING COORDINATION. ALL DIMENSIONS AND SPECIFICATIONS SHOULD BE VERIFIED BY CONSULTANT AND/OR CONTRACTOR BEFORE ACTUAL CONSTRUCTION BEGINS.

REFERENCE DRAWINGS	ISSUE	REVISIONS	DRAWN BY:	DESIGNED BY:		
			XX XX	XX XX		
			CHECKED BY:	APPROVED BY:		
			XX XX	XX XX		
			SCALE: N.T.S.	FULL SIZE ONLY		
DWG. NO.	TITLE	REV.	DATE	ISSUED FOR	REV.	DATE

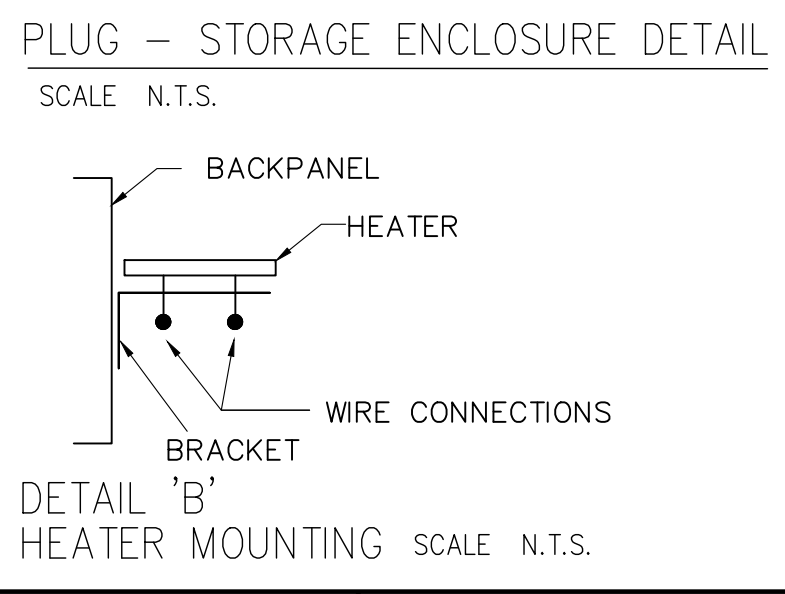

GO TRANSIT PROJECT NO. XX



XXXXXX
WAYSIDE POWER
WAYSIDE CABINET
EQUIPMENT ARRANGEMENT

CONTRACT NO. XX	DWG. NO. WSP-111	REV. 0	SHEET XX XX
--------------------	---------------------	-----------	----------------

Aug 15, 2018, 12:32pm Login Name: orade969 Drawing Name: C:\Users\orade969\Desktop\WSP\WSP-111.dwg